

LUMEL


LOW-VOLTAGES CURRENT TRANSFORMES



eximus[®] cs s.r.o.

IČO: 25322311, DIČ: CZ25322311, www.eximus.cz, eximus@eximus.cz

Čapkova 22
678 01 Blansko
Česká republika
Tel.: +420 - 516 432 681
+420 - 516 432 680
+420 - 516 433 983
+420 - 516 432 999

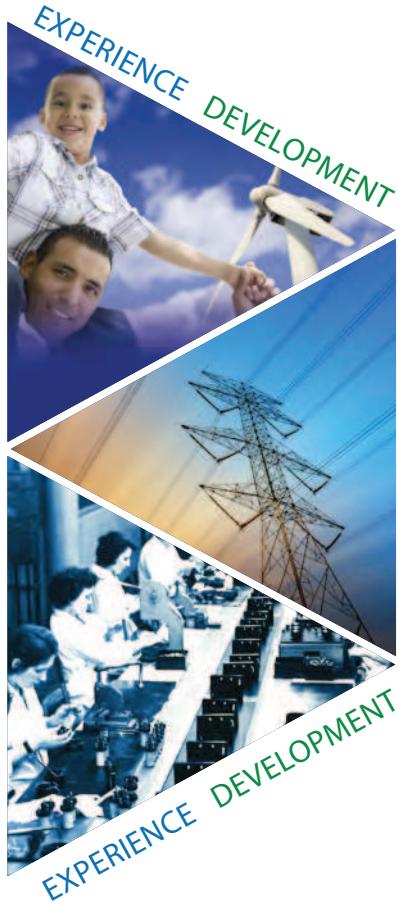

LUMEL

For over sixty years we have been providing you with all what you need, working in accordance with the highest standards. Every day thousands of our clients all over the world get our safe and user-friendly products. It wouldn't be possible without power and skills of our best specialists. We remember about every single detail

b e c a u s e

E V E R Y T H I N G C O U N T S

CONTENTS

Current transformers summary.....	4
General overview of current transformers.....	6
Instrument security factor.....	8
LCTM - wound primary series.....	14
LCTR - round conductor series.....	15
LCTB 45 - busbar series.....	17
LCTB 50 - busbar series.....	18
LCTB 62 - busbar series.....	20
LCTB 74 - busbar series.....	22
LCTB 86 - busbar series.....	24
LCTB 100 - busbar series.....	26
LCTB 104 - busbar series.....	27
LCTB 140 - busbar series.....	28
LCTB 225 - busbar series.....	30
LCTS - split core.....	31
LCTP - 3-phase current transformers.....	32
LRG - resin cast current transformers.....	34
LU01 - summation current transformers.....	38
LW - round current transformers.....	41
LE - round current transformers.....	44
Accessories.....	46



CURRENT TRANSFORMERS SUMMARY

Hole diameter/ Busbar dimensions	Transformer type	Page no.	Range of primary currents									
			Class 0.2S		Class 0.2		Class 0.5S		Class 0.5		Class 1	
			min	max	min	max	min	max	min	max	min	max
Wound primary series												
N/A	LCTM 62/W(40)	14	-	-	1 A	30 A	-	-	1 A	30 A	1 A	30 A
N/A	LCTM 74/W(40)	14	-	-	1 A	60 A	-	-	1 A	60 A	1 A	60 A
Current transformers with window for round conductor or busbar												
Ø 14	LCTR 45/14(40)	15	-	-	-	-	-	-	80 A	300 A	30 A	300 A
Ø 14	LCTR 50/14(30)	15	-	-	-	-	-	-	100 A	300 A	40 A	300 A
Ø 14	LCTR 50/14(50)	15	-	-	-	-	-	-	50 A	300 A	30 A	300 A
Ø 22	LCTR 62/R(40)	15	-	-	100 A	600 A	-	-	75 A	600 A	50 A	600 A
Ø 20 / 20 x 10	LCTB 45/21(40)	17	-	-	-	-	-	-	80 A	400 A	50 A	400 A
Ø 21 / 20 x 10	LCTB 50/21(30)	18	-	-	-	-	-	-	80 A	400 A	50 A	400 A
Ø 26 / 30 x 10	LCTB 50/30(30)	18	-	-	-	-	-	-	100 A	600 A	75 A	600 A
Ø 21 / 20 x 10	LCTB 50/21(50)	18	-	-	-	-	-	-	50 A	400 A	50 A	400 A
Ø 26 / 30 x 10	LCTB 50/30(50)	18	-	-	-	-	-	-	100 A	600 A	50 A	600 A
20 x 12	LCTB 62/20(40)	20	100 A	400 A	100 A	400 A	100 A	400 A	75 A	400 A	50 A	400 A
Ø 30 / 30 x 10	LCTB 62/30(40)	20	100 A	800 A	100 A	800 A	100 A	800 A	100 A	800 A	50 A	800 A
Ø 28 / 30 x 10	LCTB 62/30(50)	20	100 A	800 A	100 A	800 A	100 A	800 A	75 A	800 A	50 A	800 A
Ø 31 / 40 x 10	LCTB 62/40(40)	20	200 A	800 A	200 A	800 A	200 A	800 A	200 A	800 A	100 A	800 A
Ø 20 / 20 x 10	LCTB 74/20(45)	22	100 A	400 A	100 A	400 A	100 A	400 A	75 A	400 A	40 A	400 A
Ø 26 / 30 x 15	LCTB 74/30(45)	22	100 A	800 A	100 A	800 A	100 A	800 A	75 A	800 A	40 A	800 A
Ø 35 / 40 x 12	LCTB 74/40(45)	22	200 A	1000 A	200 A	1000 A	200 A	1000 A	100 A	1000 A	40 A	1000 A
Ø 41 / 50 x 12	LCTB 74/50(45)	22	250 A	1000 A	250 A	1000 A	250 A	1000 A	200 A	1000 A	100 A	1000 A
Ø 36 / 40 x 10	LCTB 86/40(45)	24	100 A	1000 A	100 A	1000 A	100 A	1000 A	100 A	1000 A	50 A	1000 A
Ø 46 / 50 x 12	LCTB 86/50(45)	24	300 A	1250 A	300 A	1250 A	300 A	1250 A	120 A	1250 A	100 A	1250 A
Ø 51 / 60 x 12	LCTB 86/60(45)	24	300 A	1600 A	300 A	1600 A	300 A	1600 A	200 A	1600 A	100 A	1600 A
Ø 54 / 60 x 12	LCTB 104/60(45)	26	300 A	1600 A	250 A	1600 A	300 A	1600 A	150 A	1600 A	100 A	1600 A
Ø 65 / 80 x 12	LCTB 104/80(45)	26	750 A	2000 A	400 A	2000 A	750 A	2000 A	250 A	2000 A	200 A	2000 A
Ø 72 / 80 x 30	LCTB 140/80(45)	27	500 A	2000 A	300 A	2000 A	500 A	2000 A	200 A	2000 A	200 A	2000 A
Ø 86 / 100 x 30	LCTB 140/100H(45)	27	600 A	4000 A	400 A	4000 A	600 A	4000 A	200 A	4000 A	200 A	4000 A
124 x 93	LCTB 225/125(50)	29	1000 A	6000 A	600 A	6000 A	1000 A	6000 A	600 A	6000 A	600 A	6000 A
166 x 65	LCTB 225/167(50)	29	1500 A	7500 A	1000 A	7500 A	1500 A	7500 A	1000 A	7500 A	1000 A	7500 A
Current transformers with vertical window for busbar or round conductor												
41 x 103	LCTB 100/100V(45)	25	1200 A	2500 A	1000 A	2500 A	1200 A	2500 A	400 A	2500 A	400 A	2500 A
38 x 128	LCTB 100/130V(45)	25	NA	NA	1500 A	3000 A	NA	NA	400 A	3000 A	400 A	3000 A
Ø 86 / 100 x 30	LCTB 140/100V(45)	27	600 A	3000 A	400 A	3000 A	600 A	3000 A	200 A	3000 A	200 A	3000 A
70 x 130	LCTB 140/130V(45)	27	NA	NA	1000 A	5000 A	NA	NA	400 A	5000 A	400 A	5000 A
Split core series												
23 x 33	LCTS 93/30SC(40)	30	NA	NA	NA	NA	NA	NA	300 A	400 A	100 A	400 A
85 x 54	LCTS 125/50SC(40)	30	NA	NA	NA	NA	NA	NA	250 A	1000 A	250 A	1000 A
85 x 125	LCTS 155/80SC(40)	30	NA	NA	NA	NA	NA	NA	250 A	3000 A	250 A	3000 A
82 x 162	LCTS 195/80SC(64)	30	NA	NA	NA	NA	NA	NA	500 A	5000 A	500 A	5000 A
3-phase current transformers												
20 x 10	LCTP 75 / 15 (60)	31	NA	NA	NA	NA	NA	NA	150 A	160 A	100 A	160 A
20 x 10	LCTP 105 / 21 (40)	31	NA	NA	NA	NA	NA	NA	160 A	250 A	100 A	250 A
30 x 15	LCTP 140 / 31 (40)	31	NA	NA	NA	NA	NA	NA	250 A	630 A	250 A	630 A
N/A	LCTP 185 / 27 (45)	32	NA	NA	NA	NA	NA	NA	NA	NA	100 A	500 A
N/A	LCTP 185 / 37 (45)	32	NA	NA	NA	NA	NA	NA	NA	NA	300 A	800 A

CURRENT TRANSFORMERS SUMMARY



Hole diameter/ Busbar dimensions	Transformer type	Page no.	Range of primary currents											
			Class 0.2S		Class 0.2		Class 0.5S		Class 0.5		Class 1		Class 5	
			min	max	min	max	min	max	min	max	min	max	min	max
Resin cast current transformers														
Ø 30	LRC1 80/30 (50)	33	-	-	-	-	-	-	NA	NA	60 A	160 A	-	-
Ø 50	LRC2 90/50 (40)	33	-	-	-	-	-	-	NA	NA	200 A	320 A	-	-
Ø 72	LRC3 110/72 (40)	34	-	-	-	-	-	-	NA	NA	400 A	630 A	-	-
Ø 85	LRC4 135/85 (40)	34	-	-	-	-	-	-	NA	NA	800 A	1250 A	-	-
Ø 115	LRC5 165/115 (40)	35	-	-	-	-	-	-	NA	NA	1500 A	2000 A	-	-
Ø 130	LRC6 195/130 (40)	35	-	-	-	-	-	-	NA	NA	2500 A	3200 A	-	-
Ø 165	LRC7 230/165 (40)	36	-	-	-	-	-	-	NA	NA	3000 A	3200 A	-	-
Ø 200	LRC8 295/200 (40)	36	-	-	-	-	-	-	NA	NA	4000 A	5000 A	-	-
Round current transformers														
Ø 30	LW01	41	-	-	-	-	-	-	100 A	200 A	50 A	200 A	-	-
Ø 30	LW02	41	-	-	200 A	200 A	150 A	200 A	75 A	200 A	50 A	200 A	-	-
Ø 43	LW03	42	-	-	200 A	300 A	200 A	300 A	100 A	300 A	75 A	300 A	-	-
Ø 58	LW04	42	-	-	400 A	600 A	200 A	600 A	150 A	600 A	120 A	600 A	-	-
Ø 72	LW05	43	-	-	400 A	1000 A	400 A	1000 A	250 A	1000 A	200 A	1000 A	-	-
Ø 113	LW06	43	-	-	600 A	3200 A	600 A	3200 A	600 A	3200 A	600 A	3200 A	-	-
Ø 30	LE 73/30 (50)	44	-	-	-	-	-	-	-	-	100 A	200 A	50 A	75 A
Ø 43	LE 92/43 (41)	44	-	-	-	-	-	-	-	-	200 A	400 A	-	-
Ø 50	LE 95/50 (40)	44	-	-	-	-	-	-	-	-	200 A	300 A	-	-
Ø 58	LE 100/58 (41)	44	-	-	-	-	-	-	-	-	400 A	600 A	-	-
Ø 72	LE 110/72 (41)	45	-	-	-	-	-	-	-	-	800 A	1000 A	-	-
Ø 85	LE 135/85 (30)	45	-	-	-	-	-	-	-	-	800 A	1200 A	-	-
Ø 113	LE 159/113 (40)	45	-	-	-	-	-	-	-	-	1200 A	2000 A	-	-
Ø 130	LE 165/130 (30)	45	-	-	-	-	-	-	-	-	2400 A	3000 A	-	-

GENERAL OVERVIEW OF CURRENT TRANSFORMERS

CURRENT TRANSFORMER is used for measurement of electric alternating currents. When current in a circuit (primary current) is too high to directly apply to measuring instruments, a current transformer produces a reduced current (secondary current) accurately proportional to the current in the circuit, which can be conveniently connected to measuring and recording instruments. A current transformer also isolates the measuring instruments from what may be very high voltage in the monitored circuit. Relationship between primary and secondary currents is called **rated transformation ratio**.

$$I_1 = I_2 \cdot \frac{N_2}{N_1}$$

where: I_1 - primary current, I_2 - secondary current, N_1 - number of turns of primary winding, N_2 - number of turns of secondary winding, N_2/N_1 - rated transformation ratio
Current transformers are used mainly in such a way that the cable from the measured shock or bus current passes through the main hole transformer, which is equivalent to one coil primary winding. In this case, the above equation simplifies to:



$$I_1 = I_2 \cdot N_2$$

The task is to reduce the transformer output current for currents of over 120% of measurement range, to protect against destruction of measuring devices connected to the transformer in case of surges or failures in the primary circuit.

FEATURES:

- Wide range of accuracy classes: 0.2S, 0.2, 0.5S, 0.5, 1; 3
- Wide range of supported primary currents, the dimensions of rails, the length of casing and hole diameters.
- Multiple mounting methods, including wall mounting, DIN rail 35mm, the conductor, a current bar.
- Shields designed to seal connections.

GENERAL SPECIFICATION

Applicable standard:

IEC 61869-1/2

Case:

10% glass filled polycarbonate, flame retardant grades classified UL 94V-0 or housing made of epoxy resin (LRC series only)

Connection:

Two connection on each side. M4 screws with self lifting clamp strap.

Insulation class

E (120°C max)

Maximum system voltage:

0.72 kV

Test voltage:

4kV, 1 min, 50Hz

Operating frequency:

3kV, 1 min, 50Hz (for LCTB 50/xx(30), LCTB 50xx(50))

Rated primary rating:

50/60 Hz

Rated secondary output:

1 A...7500 A

Rated burden:

5 A or 1 A

Accuracy class:

1, 1.25, 1.5, 2.5, 3.75, 5, 7.5, 10, 12.5, 15, 20, 30, 45, 60, 100 VA

0.2, 0.2S, 0.5S – for laboratory and power measurement

0.5 – for accurate measuring

1; 3 – for general measurement, for analog meters

Ambient temperature: -25°C ...+40°C

Operating temperature: -10°C ...+55°C

Storage temperature: -50°C...+80°C

Rated continuous thermal current (I_{cth}): 1,2 x I_n

Thermal short circuit current (I_{th}): 40 x I_n for wound type

60 x I_n for bus bar type

Dynamic short circuit current (I_{dyn}): 2.5x I_{th}

Instrument security factor (FS): 2.5, 5, 10

FEATURES:

720 V

Class
0.2S 0.2
0.5S 0.5
1 3

OUTPUTS:

5 A

1 A

DEMAND FOR POWER MEASURING DEVICES:

CT users expect these devices fulfill two basic conditions:

- a high degree of accuracy in the nominal current,
- security functions with overloads.

In order to fulfill these stipulations it is necessary for the power of a current transformer offered to fully achieve the actual power requirements of the measurement setup. In ascertaining the actual power requirements, consideration is to be made not only of the loss of power of the appliances to be connected up, but also the losses incurred by the instrument leads.

GENERAL OVERVIEW OF CURRENT TRANSFORMERS

Power requirements for measuring apparatus and relays:

- Analog moving-iron meters 0.7 – 1.5VA
- Rectifier current meters 0.001 – 0.250 VA
- Multi-range current meters 0.005 – 5.000 VA
- Current recorders 0.300-9.000 VA
- Bimetallic ammeters 2.5 – 3.0 VA
- Power meter 0.2 – 5.0 VA
- Power factor meter 2.0 – 6.0 VA
- Meters 0.4 – 1.0 VA
- Relays 0.2 – 6.0 VA
- Power transducers 0.5 VA
- Energy meters 2.5 VA

Internal losses of copper wiring:

$$P = \frac{I^2 \times 2L}{q_{CU} \times 56} \text{ [VA]}$$

Where:

I – Secondary nominal current,
L – Distance in [m],
q_{CU} – wire cross-section in [mm²].

CONNECTION DIAGRAMM OF CURRENT TRANSFORMERS

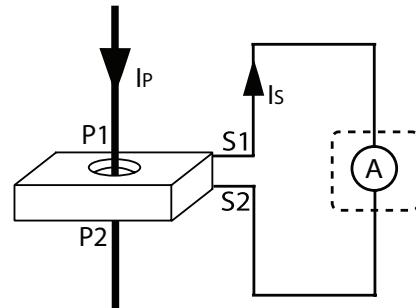


Table for values appertaining to 5 A




q _{CU}	1 m	2 m	3 m	4 m	5 m	6 m	7 m	8 m	9 m	10 m
2.5 mm ²	0.36	0.71	1.07	1.43	1.78	2.14	2.50	2.86	3.21	3.57
4.0 mm ²	0.22	0.45	0.67	0.89	1.12	1.34	1.56	1.79	2.01	2.24
6.0 mm ²	0.15	0.30	0.45	0.60	0.74	0.89	1.04	1.19	1.34	1.49
10.0 mm ²	0.09	0.18	0.27	0.36	0.44	0.54	0.63	0.71	0.80	0.89

Table for values appertaining to 1 A

q _{CU}	10 m	20 m	30 m	40 m	50 m	60 m	70 m	80 m	90 m	100 m
1.0 mm ²	0.36	0.71	1.07	1.43	1.78	2.14	2.50	2.86	3.21	3.57
2.5 mm ²	0.14	0.29	0.43	0.57	0.72	0.86	1.00	1.14	1.29	1.43
4.0 mm ²	0.09	0.18	0.27	0.36	0.45	0.54	0.63	0.71	0.80	0.89
6.0 mm ²	0.06	0.12	0.18	0.24	0.30	0.36	0.42	0.48	0.54	0.60
10.0 mm ²	0.04	0.07	0.11	0.14	0.18	0.21	0.25	0.29	0.32	0.36

Reducing the transformer ratio.

An example of measuring currents smaller than the rated current of the transformer.

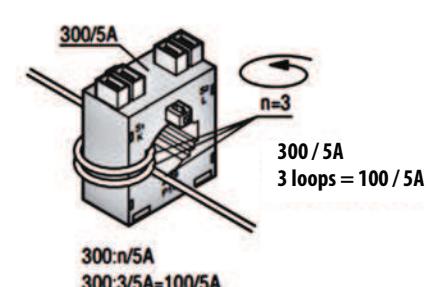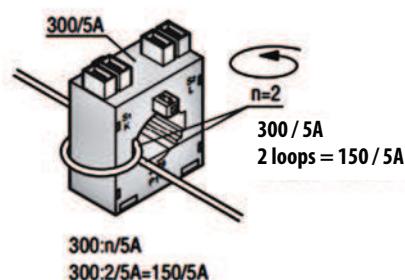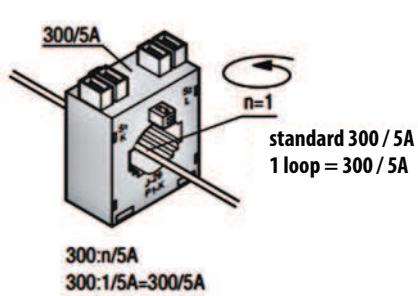

INSTRUMENT SECURITY FACTOR

INSTRUMENT SECURITY FACTOR

Transformer type	Range [A]	Instrument security factor (FS)																		
		0.25	0.2	0.55	0.5	1	3	0.25	0.2	0.55	0.5	1	0.25	0.2	0.55	0.5	1	0.25	0.2	0.55
LCTB 74/20 (45)	30	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
LCTB 74/30 (45)	40	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
LCTB 74/40 (45)	50	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
LCTB 74/50 (45)	60	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
LCTB - busbar series	75	15	5	15	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/40 (45)	80	15	5	15	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/50 (45)	100	5	15	5	10	5	5	15	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/60 (45)	120	5	15	5	10	5	5	15	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/70 (45)	125	5	15	5	10	5	5	15	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/80 (45)	150	5	15	5	10	5	5	15	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/90 (45)	200	5	10	5	5	5	5	15	5	10	5	10	5	10	5	10	5	10	5	5
LCTB 86/100 (45)	250	5	10	5	5	5	5	10	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/120 (45)	300	5	10	5	5	5	5	10	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/150 (45)	400	5	10	5	5	10	10	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/200 (45)	500	10	10	5	5	10	10	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/250 (45)	600	10	10	5	5	10	10	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/300 (45)	750	10	10	5	5	10	10	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/400 (45)	800	10	10	5	5	5	5	10	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/500 (45)	1000	5	5	5	5	5	5	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/600 (45)	1200	5	5	5	5	5	5	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/700 (45)	1250	5	5	5	5	5	5	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/800 (45)	1500	5	5	5	5	5	5	5	5	5	5	10	5	5	5	10	5	5	5	5
LCTB 86/900 (45)	1600	5	5	5	5	5	5	5	5	5	5	10	5	5	5	10	5	5	5	5

INSTRUMENT SECURITY FACTOR

Transformer type	LCTB - busbar series																						
	Instrument security factor (FS)																						
Class	0.25	0.2	0.55	0.5	1	0.2	0.5	1	0.25	0.2	0.55	0.5	1	0.25	0.2	0.55	0.5	1	0.25	0.2	0.55	0.5	1
Range [A]	100	120	125	150	200	250	300	400	500	600	750	800	1000	1200	1250	1500	1600	2000	2500	3000	4000	5000	
LCTB 100/100V (45)	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10		
LCTB 104/80 (45)	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10		
LCTB104/60 (45)	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15	15		
LCTB 100/130V (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 100/100V (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 140/100H (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 140/100V (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 140/80 (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 140/130V (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		
LCTB 140/130V (45)	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10	5	10		

INSTRUMENT SECURITY FACTOR



INSTRUMENT SECURITY FACTOR



Transformer type		LU01 - summation current transformer			
		LU01 (75)		LU01 (150)	
Class		0.5	1	0.5	1
Inputs	Power	Instrument security factor (FS)			
2x5A	5 VA	5	5		
	10 VA	5	5		
	15 VA	5	5		
	20 VA		5		
	25 VA		5		
3x5A	5 VA	5	5		
	10 VA	5	5		
	15 VA	5	5		
	20 VA		5		
	25 VA		5		
4x5A	5 VA	5	5		
	10 VA	5	5		
	15 VA	5	5		
	20 VA		5		
	25 VA		5		
5x5A	5 VA			10	10
	10 VA			5	5
	15 VA			5	5
	20 VA			5	
	25 VA			5	
6x5A	5 VA			10	10
	10 VA			5	5
	15 VA			5	5
	20 VA			5	
	25 VA			5	
7x5A	5 VA			10	10
	10 VA			10	10
	15 VA			5	5
	20 VA			5	
	25 VA			5	
8x5A	5 VA			10	10
	10 VA			10	10
	15 VA			5	5
	20 VA			5	
	25 VA			5	

INSTRUMENT SECURITY FACTOR

LW - round current transformer

NEW

Transformer type	Instrument security factor (FS)																					
	Class	0.5	1	0.2	0.5S	0.5																
Range [A]	50	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
LW01	50	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LW02	60	10	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LW03	75	10	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LW04	100	10	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LW05	120	10	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LW06	125	5	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
	150	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	200	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	250	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	300	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	400	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	500	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	600	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	800	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	1000	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	1200	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	1250	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	1500	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	1600	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	2000	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	2500	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	3000	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	3200	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	4000	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5
	5000	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	10	5	5	5

LF - round current transformer

NEW

Transformer type	Instrument security factor (FS)																					
	Class	1	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
Range [A]	50	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 165/130 (30)	50	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 159/113 (40)	60	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 135/85 (30)	75	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 110/72 (41)	100	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 100/58 (41)	120	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 95/50 (40)	125	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 92/43 (41)	150	5	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LE 73/30 (50)	200	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5

LCTM - WOUND PRIMARY SERIES



INPUT:

1 A
...
60 A


OUTPUTS:

5 A 1 A


	LCTM 62/W (40)	LCTM 74/W (45)
Depth	40 mm	45 mm
Width	62 mm	74 mm
Primary current	1 A...30 A	1 A...60 A
Secondary current		1 A, 5 A
Accuracy class		0.2; 0.5; 1

DIMENSIONS

LCTM 62/W (40)

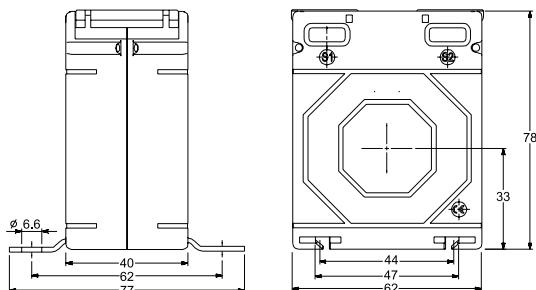

LCTM 74/W (45)

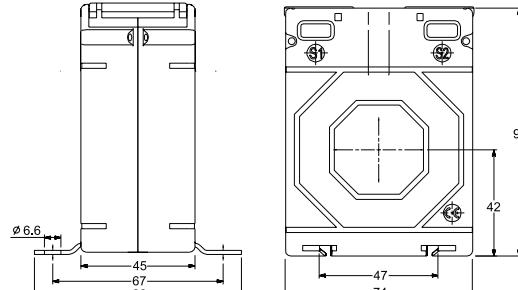

ORDERING CODES

LCTM 62W040



Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTM 62/W (40)		
Accuracy class	0,2	0,5	1
Code	2	5	1

Code	Rated primary current	Transformer burden		
0001A	1A	1 VA	2.5 VA	5 VA
02.5A	2.5 A	1 VA	2.5 VA	5 VA
0005A	5 A	1 VA	2.5 VA	5 VA
07.5A	7.5 A	1 VA	2.5 VA	5 VA
0010A	10 A	1 VA	2.5 VA	5 VA
0015A	15 A	1 VA	2.5 VA	5 VA
0020A	20 A	1 VA	2.5 VA	5 VA
0025A	25 A	1 VA	2.5 VA	5 VA
0030A	30 A	1 VA	2.5 VA	5 VA

LCTM 74W045



Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTM 74/W (45)		
Accuracy class	0.2	0.5	1
Code	2	5	1

Code	Rated primary current	Transformer burden		
0001A	1A	1.5 VA	5 VA	10 VA
02.5A	2.5 A	1.5 VA	5 VA	10 VA
0005A	5 A	1.5 VA	5 VA	10 VA
07.5A	7.5 A	1.5 VA	5 VA	10 VA
0010A	10 A	1.5 VA	5 VA	10 VA
0015A	15 A	1.5 VA	5 VA	10 VA
0020A	20 A	1.5 VA	5 VA	10 VA
0025A	25 A	1.5 VA	5 VA	10 VA
0030A	30 A	1.5 VA	5 VA	10 VA
0040A	40 A	1.5 VA	5 VA	10 VA
0050A	50 A	1.5 VA	5 VA	10 VA
0060A	60 A	1.5 VA	5 VA	10 VA

Ordering example: Order code LCTM 62W0400030A55 means the transformer LCTM 62/W(40) 30/5A; Class 0.5; power 2.5VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-124

LCTR - ROUND CONDUCTOR SERIES

	LCTR 45/14 (40)	LCTR 50/14 (30)	LCTR 50/14 (50)	LCTR 62/R (40)
Hole diameter	Ø 14 mm	Ø 14 mm	Ø 14 mm	Ø 22 mm
Depth	40 mm	31 mm	51 mm	40 mm
Width	45 mm	50 mm	50 mm	62 mm
Primary current	30 A...300 A	40 A...300 A	30 A...300 A	50 A...600 A
Secondary current		1 A, 5 A		
Accuracy class	0.5; 1; 3		0.2; 0.5S; 0.5; 1; 3	

INPUT:

30 A
...
600 A


OUTPUTS:

5 A 1 A




DIMENSIONS

LCTR 45/14 (40)

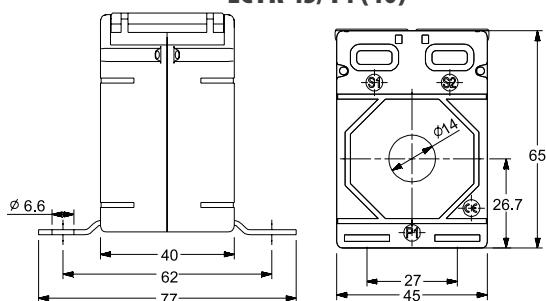

LCTR 50/14 (30)

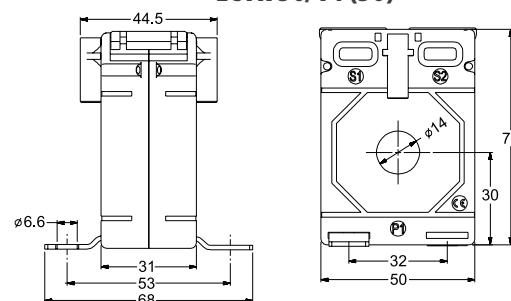

ORDERING CODES

LCTR 451440



Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTR 45/14 (40)		
Accuracy class	0.5	1	3

LCTR 501430



Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTR 50/14 (30)		
Accuracy class	0.5	1	3

Code	Rated primary current	Transformer burden			Code
		1 VA	1.5 VA	2.5 VA	
0030A	30 A	-	1 VA	1.5 VA	
0040A	40 A	-	1 VA	1.5 VA	
0050A	50 A	-	1.5 VA	2.5 VA	1
0060A	60 A	-	1.5 VA	2.5 VA	
0075A	75 A	-	2.5 VA	3.75 VA	
0080A	80 A	1 VA	2.5 VA	3.75 VA	
0100A	100 A	1.5 VA	3.75 VA	3.75 VA	
0120A	120 A	1.5 VA	3.75 VA	5 VA	
0125A	125 A	2.5 VA	3.75 VA	5 VA	5
0150A	150 A	2.5 VA	5 VA	5 VA	
0200A	200 A	3.75 VA	7.5 VA	7.5 VA	
0250A	250 A	5 VA	7.5 VA	10 VA	
0300A	300 A	5 VA	10 VA	12.5 VA	

Code	Rated primary current	Transformer burden			Code
		1 VA	1.5 VA	2.5 VA	
0040A	40 A	-	1 VA	1.5 VA	
0050A	50 A	-	1.5 VA	2 VA	
0060A	60 A	-	1.5 VA	2 VA	1
0075A	75 A	-	1.5 VA	2.5 VA	
0080A	80 A	-	1.5 VA	2.5 VA	
0100A	100 A	2.5 VA	3.75 VA	5 VA	
0120A	120 A	2.5 VA	3.75 VA	5 VA	
0125A	125 A	2.5 VA	3.75 VA	5 VA	5
0150A	150 A	3.75 VA	5 VA	7.5 VA	
0200A	200 A	3.75 VA	5 VA	7.5 VA	
0250A	250 A	5 VA	7.5 VA	7.5 VA	
0300A	300 A	7.5 VA	7.5 VA	7.5 VA	


Ordering example: Order code LCTR 4514400100A55 means the transformer LCTR 45/14(40) 100/5A meeting the requirements of the class:

- kl. 0.5 1.5 VA
- kl. 1 3.75 VA
- kl. 3 3.75 VA


LCTR - ROUND CONDUCTOR SERIES

DIMENSIONS

LCTR 50/14 (50)

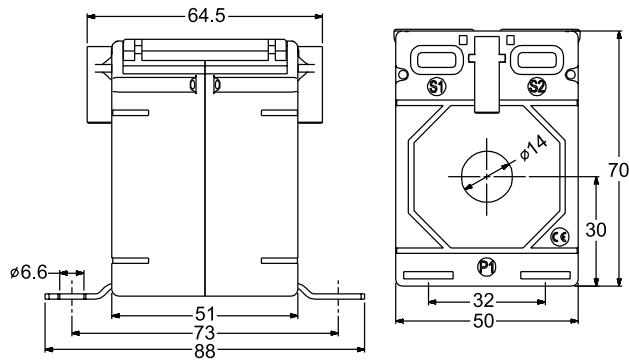

LCTR 62/R (40)

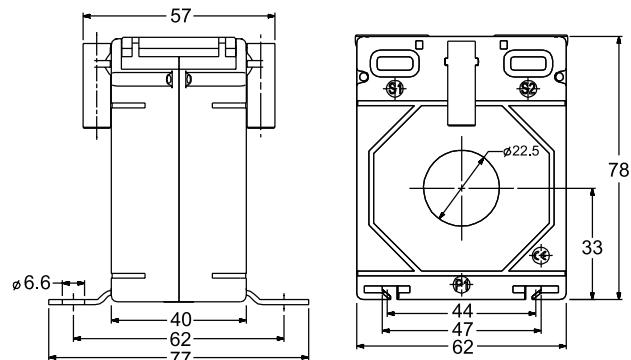

ORDERING CODES

LCTR 501450



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTR 50/14 (50)

Accuracy class

0.5

1

3

Code

Rated primary current

Transformer burden

Code

Code	30 A	-	1 VA	1 VA	1
0030A	30 A	-	1 VA	1 VA	
0040A	40 A	-	1 VA	1 VA	
0050A	50 A	1.5 VA	1.5 VA	2 VA	
0060A	60 A	1.5 VA	1.5 VA	2.5 VA	
0075A	75 A	2.5 VA	5 VA	5 VA	
0080A	80 A	2.5 VA	5 VA	7.5 VA	
0100A	100 A	3.75 VA	5 VA	7.5 VA	
0120A	120 A	3.75 VA	5 VA	7.5 VA	
0125A	125 A	3.75 VA	5 VA	7.5 VA	5
0150A	150 A	5 VA	7.5 VA	10 VA	
0200A	200 A	7.5 VA	10 VA	12.5 VA	
0250A	250 A	10 VA	12.5 VA	15 VA	
0300A	300 A	10 VA	12.5 VA	15 VA	

LCTR 62R040



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTR 62/R (40)

Accuracy class

0.2

0.5S

0.5

1

3

Code

Code	50 A	-	-	-	1.5 VA	2.5 VA	1
0050A	50 A	-	-	-	1.5 VA	2.5 VA	
0060A	60 A	-	-	-	2.5 VA	3.75 VA	
0075A	75 A	-	-	-	1.5 VA	2.5 VA	3.75 VA
0080A	80 A	-	-	-	2.5 VA	2.5 VA	3.75 VA
0100A	100 A	1.5 VA	-	-	2.5 VA	5 VA	7.5 VA
0120A	120 A	1.5 VA	-	-	3.75 VA	5 VA	7.5 VA
0125A	125 A	1.5 VA	-	-	3.75 VA	5 VA	7.5 VA
0150A	150 A	2.5 VA	2.5 VA	-	5 VA	5 VA*	7.5 VA
0200A	200 A	5 VA	5 VA	5 VA*	7.5 VA	5 VA*	10 VA
0250A	250 A	5 VA	5 VA	-	10 VA	15 VA	15 VA
0300A	300 A	5 VA	5 VA	-	10 VA	15 VA	15 VA
0400A	400 A	7.5 VA	7.5 VA	-	15 VA	15 VA	20 VA
0500A	500 A	10 VA	-	-	15 VA	15 VA	20 VA
0600A	600 A	10 VA	-	-	15 VA	15 VA	20 VA

Ordering example: Order code LCTR 5014500100A55 means the transformer LCTR 50/14(50) 100/5A meeting the requirements of the class:

- kl. 0.5 3.75 VA
- kl. 1 5 VA
- kl. 3 7.5 VA

* The custom value of the nominal power, which should be given when ordering the transformer.

ACCESSORIES:

DIN rail mounting base
- for details see page 46

LCTB 45 - BUSBAR SERIES

LCTB 45/21 (40)	
Hole diameter	Ø 20 mm
Busbar	20 x 10 mm
Depth	40 mm
Width	45 mm
Primary current	50 A...400 A
Secondary current	1 A, 5 A
Accuracy class	0.5; 1; 3

INPUT:

50 A
...
400 A



OUTPUTS:

5 A 1 A



DIMENSIONS

LCTB 45/21 (40)

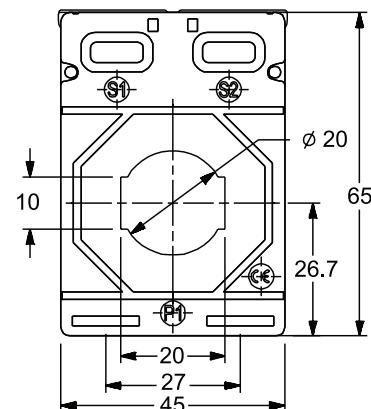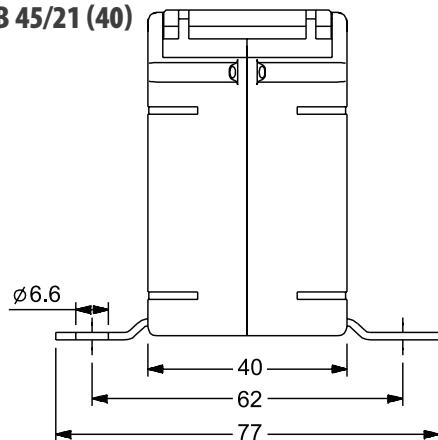

ORDERING CODES

LCTB 452140

Secondary current	Code
x/5A	5
x/1A	1

Code	Transformer type	LCTB 45/21(40)			
		Accuracy class	0.5	1	
Primary current	Transformer burden			Code	
0050A	50 A	-	1.5 VA	2 VA	
0060A	60 A	-	1.5 VA	2 VA	
0075A	75 A	-	2.5 VA	3 VA	
0080A	80 A	1 VA	2.5 VA	3 VA	
0100A	100 A	1.5 VA	3.75 VA	3.75 VA	
0120A	120 A	1.5 VA	3.75 VA	3.75 VA	
0125A	125 A	2.5 VA	3.75 VA	5 VA	1
0150A	150 A	2.5 VA	5 VA	5 VA	5
0200A	200 A	3.75 VA	5 VA	5 VA	
0250A	250 A	3.75 VA	5 VA	7.5 VA	
0300A	300 A	5 VA	5 VA	7.5 VA	
0400A	400 A	5 VA	5 VA	7.5 VA	

Ordering example: Order code LCTB 4521400100A55 means the transformer LCTB 45/21(40) 100/5A meeting the requirements of the class:

- kl. 0.5 1.5 VA
- kl. 1 3.75 VA
- kl. 3 3.75 VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-002

LCTB 50 - BUSBAR SERIES



INPUT:

40 A
...
600 A

OUTPUTS:

5 A


1 A




	LCTB 50/21 (30)	LCTB 50/30 (30)	LCTB 50/21 (50)	LCTB 50/30 (50)
Hole diameter	Ø 21 mm	Ø 26 mm	Ø 21 mm	Ø 26 mm
Busbar	20 x 10 mm	30 x 10 mm	20 x 10 mm	30 x 10 mm
Depth	31 mm	31 mm	51 mm	51 mm
Width	50 mm	50 mm	50 mm	50 mm
Primary current	40 A...400 A	75 A...600 A	50 A...400 A	50 A... 600 A
Secondary current			1 A, 5 A	
Accuracy class			0.5; 1; 3	

DIMENSIONS

LCTB 50/21 (30)

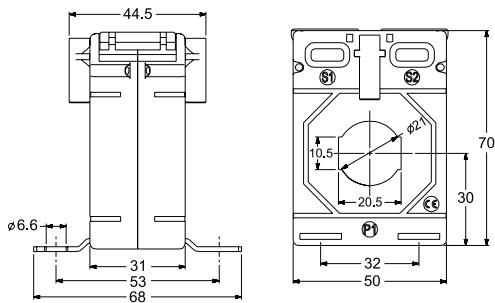

LCTB 50/30 (30)

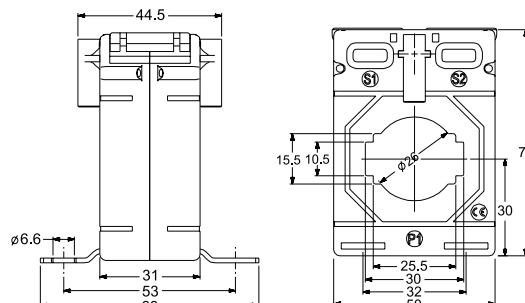

ORDERING CODES

LCTB 502130



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 50/21 (30)

Accuracy class

0.5

1

3

Code

3

LCTB 503030



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 50/30 (30)

Accuracy class

0.5

1

3

Code

1

Code	Rated primary current	Transformer burden			Code
		0.5	1	3	
0040A	40 A	-	-	1 VA	3
0050A	50 A	-	1 VA	2 VA	
0060A	60 A	-	1 VA	2 VA	1
0075A	75 A	-	1.5 VA	2.5 VA	
0080A	80 A	1 VA	2.5 VA	3.75 VA	
0100A	100 A	1.5 VA	2.5 VA	3.75 VA	
0120A	120 A	2.5 VA	2.5 VA	3.75 VA	
0125A	125 A	2.5 VA	3.75 VA	5 VA	
0150A	150 A	2.5 VA	5 VA	5 VA	5
0200A	200 A	3.75 VA	5 VA	5 VA	
0250A	250 A	5 VA	5 VA	5 VA	
0300A	300 A	5 VA	7.5 VA	7.5 VA	
0400A	400 A	5 VA	7.5 VA	7.5 VA	

Code	Rated primary current	Transformer burden			Code
		0.5	1	3	
0075A	75 A	-	1 VA	1.5 VA	1
0080A	80 A	-	1 VA	1.5 VA	
0100A	100 A	1 VA	2.5 VA	2.5 VA	
0120A	120 A	1 VA	2.5 VA	3 VA	
0125A	125 A	1 VA	2.5 VA	3 VA	
0150A	150 A	2.5 VA	3.75 VA	3.75 VA	
0200A	200 A	2.5 VA	5 VA	5 VA	
0250A	250 A	5 VA	5 VA	6.25 VA	
0300A	300 A	5 VA	5 VA	6.25 VA	
0400A	400 A	5 VA	5 VA	6.25 VA	
0500A	500 A	5 VA	6.25 VA	7.5 VA	
0600A	600 A	5 VA	7.5 VA	10 VA	


Ordering example: Order code LCTB 5021300100A55 means the transformer LCTB 50/21(30) 100/5A meeting the requirements of the class: kl. 0.5 1.5 VA; kl. 1 2.5 VA; kl. 3 3.75 VA

* The custom value of the nominal power, which should be given when ordering the transformer.


LCTB 50 - BUSBAR SERIES

DIMENSIONS

LCTB50/21 (50)

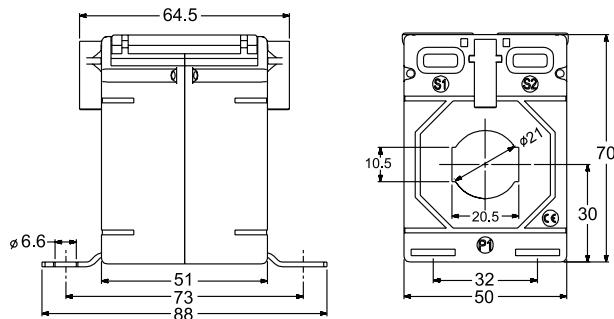

LCTB 50/30 (50)

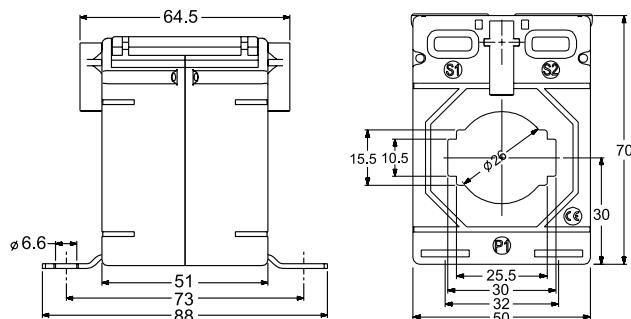

ORDERING CODES

LCTB 502150

Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 50/21 (50)

Accuracy class

0.5

1

3

Code

Rated primary current

Transformer burden

Code	Rated primary current	1 VA	2.5 VA	3 VA	Code
0050A	50 A	1 VA	2.5 VA	3 VA	
0060A	60 A	1 VA	2.5 VA	3.75 VA	
0075A	75 A	1.5 VA	2.5 VA	3.75 VA	
0080A	80 A	2.5 VA	5 VA	5 VA	
0100A	100 A	2.5 VA	5 VA	7.5 VA	
0120A	120 A	3.75 VA	5 VA	7.5 VA	
0125A	125 A	5 VA	5 VA	7.5 VA	
0150A	150 A	5 VA	10 VA	10 VA	
0200A	200 A	7.5 VA	10 VA	12.5 VA	
0250A	250 A	7.5 VA	10 VA	15 VA	
0300A	300 A	7.5 VA	12.5 VA	15 VA	
0400A	400 A	10 VA	15 VA	15 VA	

LCTB 503050

Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 50/30 (50)

Accuracy class

0.5

1

3

Code

Rated primary current

Transformer burden

Code	Rated primary current	1 VA	2.5 VA	5 VA	Code
0050A	50 A	-	1.5 VA	1.5 VA	
0060A	60 A	-	1.5 VA	2 VA	
0075A	75 A	-	2.5 VA	2.5 VA	
0080A	80 A	-	2.5 VA	3.75 VA	
0100A	100 A	1 VA	3.75 VA	3.75 VA	
0120A	120 A	2.5 VA	5 VA	5 VA	
0125A	125 A	2.5 VA	5 VA	5 VA	
0150A	150 A	5 VA	5 VA	7.5 VA	
0200A	200 A	5 VA	7.5 VA	10 VA	
0250A	250 A	5 VA	10 VA	10 VA	
0300A	300 A	5 VA	10 VA	10 VA	
0400A	400 A	10 VA	12.5 VA	12.5 VA	
0500A	500 A	10 VA	12.5 VA	15 VA	
0600A	600 A	10 VA	15 VA	15 VA	

Ordering example: Order code LCTB 5021500100A55 means the transformer LCTB 50/21(50) 100/5A meeting the requirements of the class:

- kl. 0.5 2.5 VA
- kl. 1 5 VA
- kl. 3 7.5 VA

ACCESSORIES:

DIN rail mounting base

- for details see page 46

LCTB 62 - BUSBAR SERIES



INPUT:

40 A
...
800 A

OUTPUTS:


5 A 1 A




	LCTB 62/20 (40)	LCTB 62/30 (40)	LCTB 62/30 (50)	LCTB 62/40 (40)
Hole diameter	-	Ø 30 mm	Ø 28 mm	Ø 31 mm
Busbar	20x12 mm	30x10 mm, 2x25x10 mm	30x10 mm	40x10 mm, 2x30x10 mm
Depth	40 mm	40 mm	50 mm	40 mm
Width	62 mm	62 mm	62 mm	62 mm
Primary current	50A...400A	50 A...800 A	40 A...800 A	100 A...800 A
Secondary current			1 A, 5 A	
Accuracy class			0.2S; 0.2; 0.5S; 0.5; 1; 3	

DIMENSIONS

LCTB 62/20 (40)

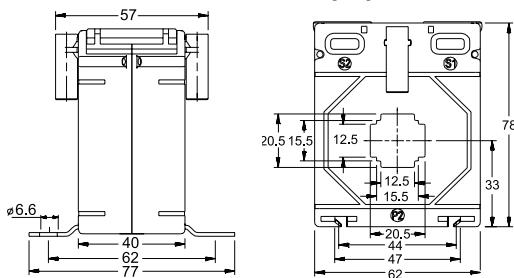

LCTB 62/30 (40)

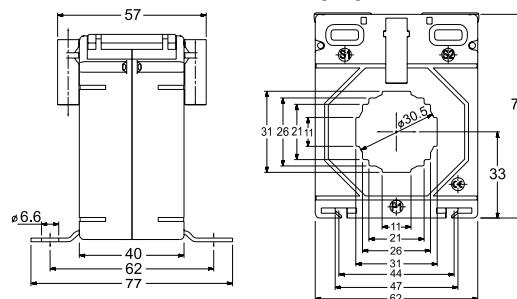

ORDERING CODES

LCTB 622040

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 62/20 (40)					
Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-

LCTB 623040

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 62/30 (40)					
Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-


Code	Rated primary current	Transformer burden						Code	Rated primary current	Transformer burden					
		0.5	1	3	5	10	20			0.5	1	3	5	10	20
0050A	50 A	-	-	-	-	1.5 VA	2.5 VA	1	50 A	-	-	-	-	1.25 VA	2 VA
0060A	60 A	-	-	-	-	2.5 VA	3.75 VA		60 A	-	-	-	-	1.5 VA	2 VA
0075A	75 A	-	-	-	1.5 VA	3.75 VA	3.75 VA	5	75 A	-	-	-	-	1.5 VA	2 VA
0080A	80 A	-	-	-	2.5 VA	3.75 VA	3.75 VA		80 A	-	-	-	-	2 VA	2.5 VA
0100A	100 A	1.5 VA	1.5 VA	1.5 VA	2.5 VA	5 VA	7.5 VA	10	100 A	1 VA	1 VA	1 VA	1.5 VA	2.5 VA	3.75 VA
0120A	120 A	1.5 VA	1.5 VA	1.5 VA	3.75 VA	5 VA	7.5 VA		120 A	1 VA	1 VA	1 VA	2.5 VA	3.75 VA	5 VA
0125A	125 A	1.5 VA	1.5 VA	1.5 VA	3.75 VA	5 VA	7.5 VA	5	125 A	1 VA	1 VA	1 VA	2.5 VA	3.75 VA	5 VA
0150A	150 A	2 VA	2.5 VA	2.0 VA	5 VA	7.5 VA	10 VA	10	150 A	2.5 VA	1.5 VA	2.5 VA	3.75 VA	5 VA	7.5 VA
0200A	200 A	3.75 VA	5 VA	3.75 VA	7.5 VA	10 VA	12.5 VA	15	200 A	5 VA	2.5 VA	5 VA	5 VA	7.5 VA	10 VA
0250A	250 A	3.75 VA	5 VA	3.75 VA	10 VA	15 VA	15 VA		250 A	5 VA	3.75 VA	5 VA	5 VA	10 VA	15 VA
0300A	300 A	3.75 VA	5 VA	3.75 VA	10 VA	15 VA	15 VA	15	300 A	5 VA	3.75 VA	5 VA	5 VA	10 VA	15 VA
0400A	400 A	5 VA	7.5 VA	5 VA	15 VA	15 VA	20 VA		400 A	5 VA	5 VA	5 VA	7.5 VA	12.5 VA	15 VA

Ordering example: Order code LCTB 6220400100A55 means the transformer LCTB 62/20(40) 100/5A meeting the requirements of the class: kl. 0.5 - 2.5 VA; kl. 1 - 5 VA; kl. 3 - 7.5 VA


LCTB 62 - BUSBAR SERIES

DIMENSIONS

LCTB 62/30 (50)

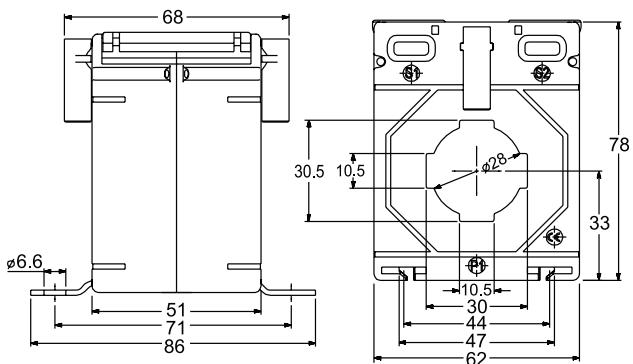

LCTB 62/40 (40)

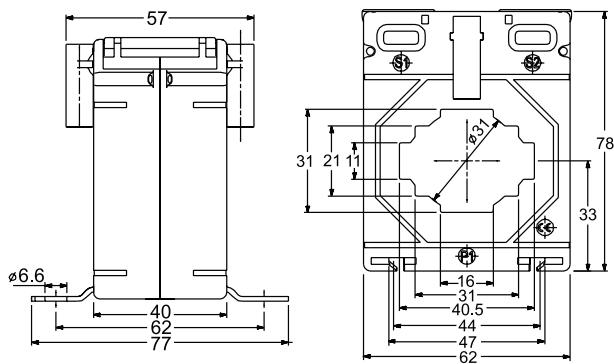

ORDERING CODES

LCTB 623050

Secondary current	Code
x/5A	5
x/1A	1

Transformer type LCTB 62/30 (50)

Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R			

Code	Rated primary current	Transformer burden						Code
0040A	40 A	-	-	-	-	-	1 VA	3
0050A	50 A	-	-	-	-	1.5 VA	2.5 VA	1
0060A	60 A	-	-	-	-	2.5 VA	3.75 VA	
0075A	75 A	-	-	-	2.5 VA	2.5 VA	3.75 VA	
0080A	80 A	-	-	-	2.5 VA	3.75 VA	5 VA	
0100A	100 A	1.25 VA	1.25 VA	1.25 VA	2.5 VA	5 VA	7.5 VA	
0120A	120 A	1.25 VA	1.25 VA	1.25 VA	5 VA	5 VA	7.5 VA	
0125A	125 A	1.25 VA	1.25 VA	1.25 VA	5 VA	5 VA	7.5 VA	
0150A	150 A	2 VA	2 VA	2 VA	5 VA	7.5 VA	10 VA	
0200A	200 A	5 VA	3.75 VA	5 VA	10 VA	15 VA	15 VA	
0250A	250 A	5 VA	5 VA	5 VA	15 VA	15 VA	20 VA	
0300A	300 A	5 VA	5 VA	5 VA	15 VA	15 VA	20 VA	
0400A	400 A	10 VA	6.25 VA	10 VA	15 VA	30 VA	30 VA	
0500A	500 A	5 VA	7.5 VA	5 VA	15 VA	30 VA	30 VA	
0600A	600 A	6.25 VA	10 VA	6.25 VA	20 VA	30 VA	30 VA	
0750A	750 A	6.25 VA	10 VA	6.25 VA	20 VA	30 VA	30 VA	
0800A	800 A	6.25 VA	10 VA	6.25 VA	20 VA	30 VA	35 VA	

LCTB 624040

Secondary current	Code
x/5A	5
x/1A	1

Transformer type LCTB 62/40 (40)

Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-

Code
1
5

* The custom value of the nominal power, which should be given when ordering the transformer.

Ordering example: Order code LCTB 6230500100A55 means the transformer LCTB 62/30(50) 100/5A meeting the requirements of the class:

- kl. 0.5 2.5 VA
- kl. 1 5 VA
- kl. 3 7.5 VA

ACCESSORIES:

DIN rail mounting base
- for details see page 46

LCTB 74 - BUSBAR SERIES



INPUT:

**30 A
...
1000 A**

OUTPUTS:


5 A

1 A


	LCTB 74/20 (45)	LCTB 74/30 (45)	LCTB 74/40 (45)	LCTB 74/50 (45)
Hole diameter	Ø 20 mm	Ø 26 mm	Ø 35 mm	Ø 41 mm
Busbar	20x10 mm	30x15 mm, 2x20x10 mm	40x12 mm, 2x30x15 mm	50x12 mm, 2x40x10 mm
Depth	45 mm	45 mm	45 mm	45 mm
Width	74 mm	74 mm	74 mm	74 mm
Primary current	30 A...400 A	30 A...800 A	40 A...1000 A	100 A...1000 A
Secondary current			1 A, 5 A	
Accuracy class			0.25; 0.2; 0.5S; 0.5; 1; 3	

DIMENSIONS

LCTB 74/20 (45)

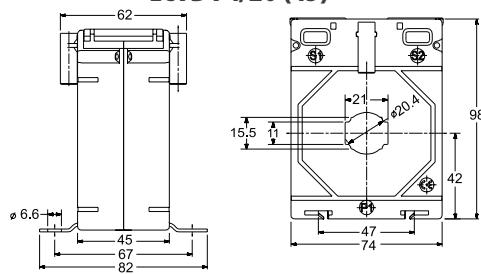

LCTB 74/30 (45)

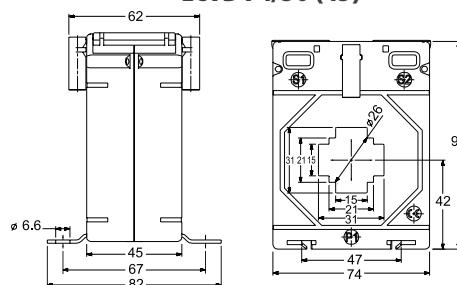

ORDERING CODES

LCTB 742045



LCTB 743045



Transformer type	LCTB 74/20 (45)							
	Accuracy class	0.2S	0.2	0.5S	0.5	1		
		Code	S	2	R	-		
Code	Rated primary current	Transformer burden				Code		
0030A	30 A	-	-	-	-	1.5 VA	3	
0040A	40 A	-	-	-	-	1.5 VA	2 VA	
0050A	50 A	-	-	-	-	2.5 VA	3.75 VA	1
0060A	60 A	-	-	-	-	3.75 VA	5 VA	
0075A	75 A	-	-	-	1.5 VA	5 VA	7.5 VA	
0080A	80 A	-	-	-	1.5 VA	5 VA	7.5 VA	
0100A	100 A	1.5 VA	1.5 VA	1.5 VA	5 VA	7.5 VA	10 VA	
0120A	120 A	1.5 VA	1.5 VA	1.5 VA	5 VA	10 VA	12.5 VA	
0125A	125 A	1.5 VA	1.5 VA	1.5 VA	5 VA	10 VA	12.5 VA	5
0150A	150 A	2.5 VA	2.5 VA	2.5 VA	7.5 VA	12.5 VA	15 VA	
0200A	200 A	5 VA	5 VA	5 VA	10 VA	15 VA	20 VA	
0250A	250 A	5 VA	5 VA	5 VA	10 VA	15 VA	20 VA	
0300A	300 A	5 VA	7.5 VA	5 VA	15 VA	15 VA	20 VA	
0400A	400 A	5 VA	10 VA	5 VA	15 VA	20 VA	25 VA	


Code	Rated primary current	Transformer burden						Code	
		-	-	-	-	-	-		
0030A	30 A	-	-	-	-	-	-	1 VA	3
0040A	40 A	-	-	-	-	-	-	1.5 VA	1.5 VA
0050A	50 A	-	-	-	-	-	-	1.5 VA	2.5 VA
0060A	60 A	-	-	-	-	-	-	2.5 VA	3.75 VA
0075A	75 A	-	-	-	1.5 VA	5 VA	7.5 VA	1.5 VA	2.5 VA
0080A	80 A	-	-	-	1.5 VA	5 VA	7.5 VA	1.5 VA	3.75 VA
0100A	100 A	1.5 VA	1.5 VA	1.5 VA	5 VA	7.5 VA	10 VA	1.5 VA	2.5 VA
0120A	120 A	1.5 VA	1.5 VA	1.5 VA	5 VA	10 VA	12.5 VA	1.5 VA	2.5 VA
0125A	125 A	1.5 VA	1.5 VA	1.5 VA	5 VA	10 VA	12.5 VA	1.5 VA	2.5 VA
0150A	150 A	2.5 VA	2.5 VA	2.5 VA	7.5 VA	12.5 VA	15 VA	2.5 VA	5 VA
0200A	200 A	5 VA	5 VA	5 VA	10 VA	15 VA	20 VA	10 VA	15 VA
0250A	250 A	5 VA	5 VA	5 VA	10 VA	15 VA	20 VA	10 VA	15 VA
0300A	300 A	5 VA	7.5 VA	5 VA	15 VA	15 VA	20 VA	10 VA	15 VA
0400A	400 A	5 VA	10 VA	5 VA	15 VA	20 VA	25 VA	15 VA	20 VA
0500A	500 A	5 VA	10 VA	5 VA	15 VA	20 VA	25 VA	15 VA	20 VA
0600A	600 A	5 VA	15 VA	5 VA	15 VA	20 VA	25 VA	20 VA	25 VA
0750A	750 A	7.5 VA	20 VA	7.5 VA	20 VA	30 VA	30 VA	30 VA	30 VA
0800A	800 A	10 VA	30 VA	10 VA	30 VA	30 VA	35 VA	30 VA	35 VA

Ordering example: Order code LCTB 7420450100A55 means the transformer LCTB 74/20(45) 100/5A meeting the requirements of the class: kl. 0.5 - 5 VA; kl. 1 - 7.5 VA; kl. 3 - 10 VA


LCTB 74 - BUSBAR SERIES

DIMENSIONS

LCTB 74/40 (45)

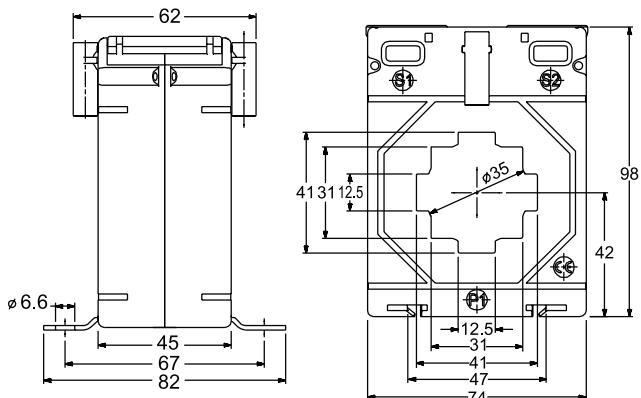

LCTB 74/50 (45)

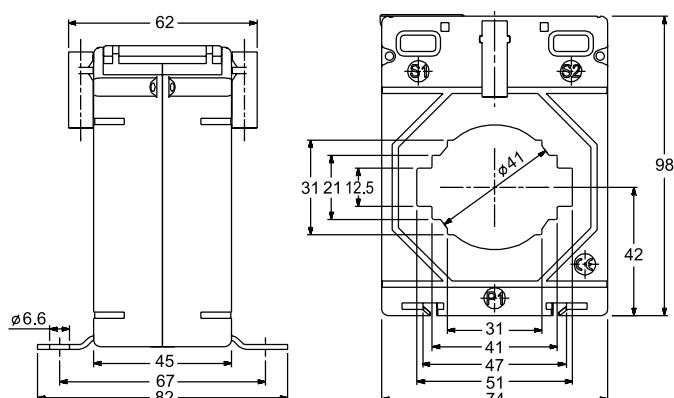

ORDERING CODES

LCTB 744045



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 74/40 (45)

Accuracy class

0.2S 0.2 0.5S 0.5 1 3

Code

S 2 R

LCTB 745045



Secondary current

Code

x/5A

5

x/1A

1

Transformer type

LCTB 74/50 (45)

Accuracy class

0.2S 0.2 0.5S 0.5 1 3

Code

S 2 R

Code	Rated primary current	Transformer burden						Code
		0.2S	0.2	0.5S	0.5	1	3	
0040A	40 A	-	-	-	-	1 VA	1 VA	
0050A	50 A	-	-	-	-	1 VA	1.5 VA	
0060A	60 A	-	-	-	-	1 VA	1.5 VA	1
0075A	75 A	-	-	-	-	1.5 VA	2.5 VA	
0080A	80 A	-	-	-	-	1.5 VA	2.5 VA	
0100A	100 A	-	-	-	1.5 VA	2.5 VA	3.75 VA	
0120A	120 A	-	-	-	1.5 VA	2.5 VA	3.75 VA	
0125A	125 A	-	-	-	1.5 VA	2.5 VA	3.75 VA	
0150A	150 A	-	-	-	2.5 VA	3.75 VA	5 VA	
0200A	200 A	2.5 VA	2.5 VA	2.5 VA	3.75 VA	5 VA	7.5 VA	
0250A	250 A	5 VA	2.5 VA	5 VA	5 VA	7.5 VA	10 VA	
0300A	300 A	5 VA	2.5 VA	5 VA	5 VA	7.5 VA	10 VA	5
0400A	400 A	5 VA	5 VA	5 VA	5 VA*	7.5 VA	12.5 VA	
0500A	500 A	5 VA	7.5 VA	5 VA	10 VA	15 VA	15 VA	
0600A	600 A	5 VA	10 VA	5 VA	15 VA	20 VA	20 VA	
0750A	750 A	5 VA	10 VA	5 VA	15 VA	20 VA	20 VA	
0800A	800 A	7.5 VA	15 VA	7.5 VA	15 VA	20 VA	25 VA	
1000A	1000 A	10 VA	15 VA	10 VA	15 VA	20 VA	25 VA	

Code	Rated primary current	Transformer burden						Code
		0.2S	0.2	0.5S	0.5	1	3	
0100A	100 A	-	-	-	-	-	1.5 VA	2 VA
0120A	120 A	-	-	-	-	-	1.5 VA	2.5 VA
0125A	125 A	-	-	-	-	-	1.5 VA	2.5 VA
0150A	150 A	-	-	-	-	-	2.5 VA	3.75 VA
0200A	200 A	-	-	-	-	-	1.5 VA	3.75 VA
0250A	250 A	1.5 VA	1.5 VA	1.5 VA	1.5 VA	2.5 VA	5 VA	7.5 VA
0300A	300 A	1.5 VA	1.5 VA	1.5 VA	1.5 VA	5 VA	7.5 VA	7.5 VA
0400A	400 A	2.5 VA	2.5 VA	2.5 VA	2.5 VA	5 VA	7.5 VA	10 VA
0500A	500 A	5 VA	5 VA	5 VA	5 VA	7.5 VA	10 VA	12.5 VA
0600A	600 A	5 VA	5 VA*	7.5 VA	5 VA	10 VA	12.5 VA	15 VA
0750A	750 A	5 VA	10 VA	5 VA	10 VA	5 VA	12.5 VA	15 VA
0800A	800 A	5 VA	10 VA	5 VA	10 VA	5 VA	12.5 VA	15 VA
1000A	1000 A	5 VA	10 VA	5 VA	10 VA	5 VA	12.5 VA	20 VA

*The custom value of the nominal power, which should be given when ordering the transformer.

*The custom value of the nominal power, which should be given when ordering the transformer.

Ordering example: Order code LCTB 7450450300A55 means the transformer LCTB 74/50(45) 300/5A meeting the requirements of the class: kl. 0.5 - 5 VA; kl. 1 - 7.5 VA; kl. 3 - 7.5 VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-124

LCTB 86 - BUSBAR SERIES



CE

INPUT:

50 A
...
1600 A


OUTPUTS:

5 A 1 A


	LCTB 86/40 (45)	LCTB 86/50 (45)	LCTB 86/60 (45)
Hole diameter	Ø 36 mm	Ø 46 mm	Ø 51 mm
Busbar	40 x 10 mm, 2x30x15mm	50 x 12 mm, 2x40 x 15 mm	60 x 12 mm, 2x50 x 15 mm
Depth	45 mm	45 mm	45 mm
Width	86 mm	86 mm	86 mm
Primary current	50 A...1000 A	100 A...1250 A	100 A...1600 A
Secondary current		1A, 5A	
Accuracy class		0.2S; 0.2; 0.5S; 0.5; 1; 3	

DIMENSIONS


LCTB 86/40 (45)

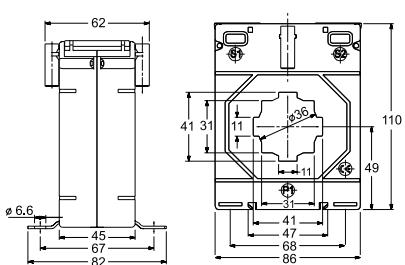

LCTB 86/50 (45)

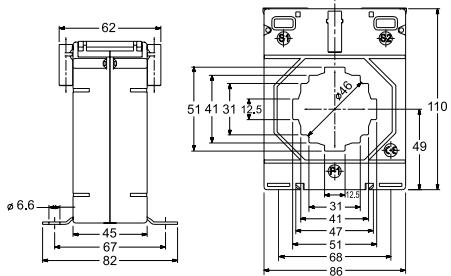

LCTB 86/60 (45)

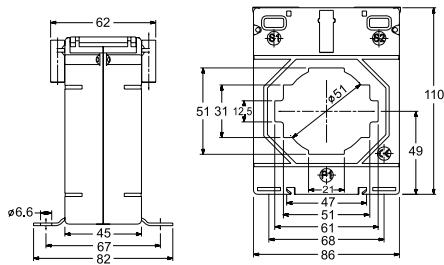

ORDERING CODES

LCTB 864045



Secondary current

Code

X/5A

5

X/1A

1

Transformer type	LCTB 86/40 (45)						
	Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-	-

Code	Primary current	Transformer burden						Code
		1.5 VA	2.5 VA	3.75 VA	5 VA	7.5 VA	10 VA	
0050A	50 A	-	-	-	-	1.5 VA	1.5 VA	
0060A	60 A	-	-	-	-	1.5 VA	2 VA	
0075A	75 A	-	-	-	-	2.5 VA	3.75 VA	
0080A	80 A	-	-	-	-	2.5 VA	3.75 VA	
0100A	100 A	1.5 VA	1.5 VA	1.5 VA	1.5 VA	3.75 VA	5 VA	
0120A	120 A	1.5 VA	1.5 VA	1.5 VA	2.5 VA	5 VA	7.5 VA	
0125A	125 A	1.5 VA	1.5 VA	1.5 VA	2.5 VA	5 VA	7.5 VA	
0150A	150 A	2.5 VA	2.5 VA	2.5 VA	3.75 VA	5 VA	7.5 VA	
0200A	200 A	5 VA	2.5 VA	2.5 VA	5 VA	7.5 VA	10 VA	
0250A	250 A	10 VA	3.75 VA	3.75 VA	7.5 VA	12.5 VA	15 VA	
0300A	300 A	10 VA	5 VA	10 VA	10 VA	15 VA	20 VA	5
0400A	400 A	10 VA	7.5 VA	7.5 VA	15 VA	20 VA	25 VA	
0500A	500 A	5 VA	10 VA	10 VA	20 VA	30 VA	35 VA	
0600A	600 A	7.5 VA	15 VA	15 VA	30 VA	30 VA	35 VA	
0750A	750 A	7.5 VA	15 VA	15 VA	30 VA	30 VA	35 VA	
0800A	800 A	10 VA	15 VA	15 VA	30 VA	30 VA	35 VA	
1000A	1000 A	10 VA	15 VA	15 VA	30 VA	30 VA	35 VA	

Ordering example: Order code LCTB 8640450100A55 means the transformer LCTB 86/40(45) 100/5A meeting the requirements of the class:

- kl. 0.5 1.5 VA
- kl. 1 3.75 VA

ORDERING CODES

LCTB 865045

Secondary current	Code
x/5A	5
x/1A	1

LCTB 866045

Secondary current	Code
x/5A	5
x/1A	1

LCTB 86/50 (45)

Transformer type	LCTB 86/50 (45)							
Accuracy class	0.2S	0.2	0.5S	0.5	1	3		
Code	S	2	R	-	-	-		
Code	Primary current	Transformer burden				Code		
0100A	100 A	-	-	-	-	1.5 VA	2.5 VA	1
0120A	120 A	-	-	-	-	1.5 VA	2.5 VA	3.75 VA
0125A	125 A	-	-	-	-	1.5 VA	2.5 VA	3.75 VA
0150A	150 A	-	-	-	-	2.5 VA	5 VA	7.5 VA
0200A	200 A	-	-	-	-	5 VA	7.5 VA	10 VA
0250A	250 A	-	-	-	-	7.5 VA	10 VA	12.5 VA
0300A	300 A	5 VA	1.5 VA	5 VA	7.5 VA	10 VA	15 VA	
0400A	400 A	7.5 VA	2.5 VA	7.5 VA	15 VA	15 VA	20 VA	5
0500A	500 A	7.5 VA	5 VA	7.5 VA	15 VA	20 VA	20 VA	
0600A	600 A	10 VA	7.5 VA	10 VA	15 VA	20 VA	20 VA	
0750A	750 A	7.5 VA	10 VA	7.5 VA	15 VA	20 VA	25 VA	
0800A	800 A	10 VA	12.5 VA	10 VA	20 VA	30 VA	30 VA	
1000A	1000 A	12.5 VA	20 VA	12.5 VA	30 VA	30 VA	35 VA	
1200A	1200 A	12.5 VA	20 VA	12.5 VA	30 VA	30 VA	35 VA	
1250A	1250 A	12.5 VA	20 VA	12.5 VA	30 VA	30 VA	35 VA	

LCTB 86/60 (45)

Transformer type	LCTB 86/60 (45)							
Accuracy class	0.2S	0.2	0.5S	0.5	1	3		
Code	S	2	R	-	-	-		
Code	Primary current	Transformer burden				Code		
0100A	100 A	-	-	-	-	1 VA	1.5 VA	1
0120A	120 A	-	-	-	-	1.5 VA	2.5 VA	
0125A	125 A	-	-	-	-	2.5 VA	3.75 VA	1
0150A	150 A	-	-	-	-	2.5 VA	3.75 VA	
0200A	200 A	-	-	-	-	1.5 VA	3.75 VA	5 VA
0250A	250 A	-	-	-	-	2.5 VA	5 VA	7.5 VA
0300A	300 A	1.5 VA	1.5 VA	1.5 VA	1.5 VA	5 VA	7.5 VA	10 VA
0400A	400 A	2.5 VA	2.5 VA	2.5 VA	10 VA	12.5 VA	15 VA	
0500A	500 A	2.5 VA	3.75 VA	2.5 VA	10 VA	12.5 VA	15 VA	
0600A	600 A	5 VA	5 VA	5 VA	15 VA	15 VA	20 VA	
0750A	750 A	5 VA	10 VA	5 VA	15 VA	20 VA	25 VA	5
0800A	800 A	7.5 VA	12.5 VA	7.5 VA	20 VA	20 VA	25 VA	
1000A	1000 A	10 VA	15 VA	10 VA	20 VA	20 VA	25 VA	
1200A	1200 A	10 VA	15 VA	10 VA	20 VA	20 VA	25 VA	
1250A	1250 A	10 VA	15 VA	10 VA	20 VA	20 VA	25 VA	
1500A	1500 A	10 VA	15 VA	10 VA	20 VA	20 VA	25 VA	
1600A	1600 A	10 VA	15 VA	10 VA	20 VA	20 VA	25 VA	

Ordering example: Order code LCTB 8650450300A55 means the transformer LCTB 86/50(45) 300/5A meeting the requirements of the class:

- kl. 0.5 7.5 VA
- kl. 1 10 VA
- kl. 3 15 VA

ACCESSORIES:
DIN rail mounting base
Order code: LH000-0904-130-124

LCTB 100 - BUSBAR SERIES



CE

INPUT:

400 A
...
3000 A

OUTPUTS:

5 A 1 A


LCTB 100/100V (45)

LCTB 100/130V (45)


Busbar	41 x 103 mm	38 x 128 mm
Depth	45 mm	45 mm
Width	100 mm	100 mm
Primary current	400 A...2500 A	400 A...3000 A
Secondary current	1 A, 5 A	
Accuracy class	0.2S; 0.2; 0.5S; 0.5; 1	0.2; 0.5; 1

DIMENSIONS

LCTB 100/100V (45)

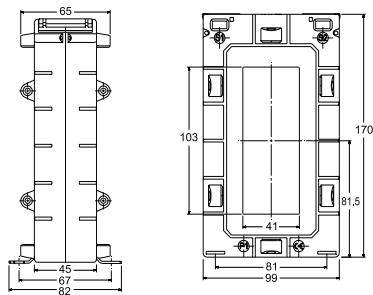

LCTB 100/130V (45)

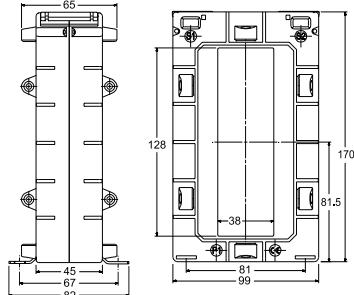

ORDERING CODES

LCTB 100100

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 100/100V (45)					
Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-

Code	Rated primary current	Transformer burden						Code
0400A	400 A	-	-	-	2.5 VA	5 VA	5 VA	5
0500A	500 A	-	-	-	2.5 VA	5 VA	6.25 VA	
0600A	600 A	-	-	-	2.5 VA	5 VA	7.5 VA	
0750A	750 A	-	-	-	2.5 VA	5 VA	7.5 VA	
0800A	800 A	-	-	-	5 VA	10 VA	10 VA	
1000A	1000 A	-	5 VA	-	10 VA	15 VA	15 VA	
1200A	1200 A	5 VA	5 VA	5 VA	10 VA	15 VA	15 VA	
1250A	1250 A	5 VA	5 VA	5 VA	10 VA	15 VA	20 VA	
1500A	1500 A	5 VA	5 VA	5 VA	15 VA	30 VA	30 VA	
1600A	1600 A	7.5 VA	10 VA	7.5 VA	15 VA	30 VA	30 VA	
2000A	2000 A	7.5 VA	10 VA	7.5 VA	15 VA	30 VA	35 VA	
2500A	2500 A	10 VA	10 VA	10 VA	15 VA	20 VA	35 VA	

LCTB 100130

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 100/130V (45)			
Accuracy class	0.2	0.5	1	3
Code	2	-	-	-

Code	Rated primary current	Transformer burden				Code
0400A	400 A	-	2.5 VA	5 VA	5 VA	5
0500A	500 A	-	2.5 VA	5 VA	6.25 VA	
0600A	600 A	-	2.5 VA	5 VA	7.5 VA	
0750A	750 A	-	2.5 VA	7.5 VA	7.5 VA	
0800A	800 A	-	5 VA	7.5 VA	10 VA	
1000A	1000 A	-	10 VA	10 VA	15 VA	
1200A	1200 A	-	10 VA	15 VA	15 VA	
1250A	1250 A	-	10 VA	15 VA	20 VA	
1500A	1500 A	5 VA	15 VA	30 VA	30 VA	
1600A	1600 A	5 VA	15 VA	30 VA	30 VA	
2000A	2000 A	5 VA	15 VA	30 VA	30 VA	
2500A	2500 A	5 VA	15 VA	30 VA	35 VA	
3000A	3000 A	5 VA	10 VA	12.5 VA	35 VA	

Ordering example: Order code LCTB 1001001500A55 means the transformer LCTB 100/100V(45) 1500/5A meeting the requirements of the class: kl. 0.5 - 15 VA; kl. 1 - 30 VA ; kl. 3 - 30 VA

LCTB 104 - BUSBAR SERIES

	LCTB 104/60 (45)	LCTB 104/80 (45)
Hole diameter	Ø 54 mm	Ø 65 mm
Busbar	60 x 12 mm, 2 x 50 x 15 mm, 2 x 40 x 20 mm	80 x 12 mm, 2 x 60 x 15 mm, 2 x 50 x 25 mm
Depth	45 mm	45 mm
Width	104 mm	104 mm
Primary current	100 A...1600 A	200 A...2000 A
Secondary current	1 A, 5 A	
Accuracy class	0,25; 0,2; 0,55; 0,5; 1	

INPUT:

100 A
...
2000 A




OUTPUTS:

5 A 1 A




DIMENSIONS

LCTB 104/60 (45)

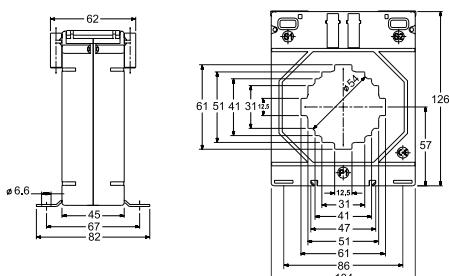


LCTB 104/80 (45)

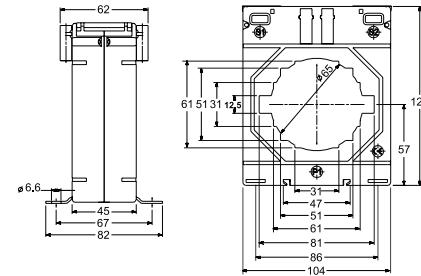

ORDERING CODES

LCTB 104604



Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 104/60 (45)						
	Accuracy class	0.25	0.2	0.55	0.5	1	3
	Code	S	2	R	-	-	-

Code	Rated primary current	Transformer burden						Code
		100 A	120 A	125 A	150 A	200 A	250 A	
0100A	100 A	-	-	-	-	1.5 VA	2.5 VA	1
0120A	120 A	-	-	-	-	2.5 VA	3.75 VA	
0125A	125 A	-	-	-	-	2.5 VA	3.75 VA	
0150A	150 A	-	-	-	2.5 VA	5 VA	7.5 VA	
0200A	200 A	-	-	-	5 VA	10 VA	12.5 VA	
0250A	250 A	-	1.5 VA	-	7.5 VA	12.5 VA	15 VA	
0300A	300 A	1.5 VA	2.5 VA	1.5 VA	10 VA	15 VA	15 VA	
0400A	400 A	2.5 VA	3.75 VA	2.5 VA	5 VA 10 VA*	15 VA	20 VA	
0500A	500 A	3.75 VA	7.5 VA	3.75 VA	15 VA	20 VA	20 VA	
0600A	600 A	5 VA	10 VA	5 VA	15 VA	30 VA	25 VA	5
0750A	750 A	5 VA	15 VA	5 VA	20 VA	30 VA	30 VA	
0800A	800 A	7.5 VA	15 VA	7.5 VA	30 VA	30 VA	35 VA	
1000A	1000 A	10 VA	20 VA	10 VA	30 VA	45 VA	35 VA	
1200A	1200 A	10 VA	30 VA	10 VA	30 VA	45 VA	45 VA	
1250A	1250 A	10 VA	30 VA	10 VA	30 VA	45 VA	50 VA	
1500A	1500 A	10 VA	30 VA	10 VA	30 VA	45 VA	50 VA	
1600A	1600 A	10 VA	30 VA	10 VA	30 VA	45 VA	50 VA	

* The custom value of the nominal power, which should be given when ordering the transformer.

Ordering example: Order code LCTB 1046041500A55 means the transformer LCTB 104/60(45) 1500/5A meeting the requirements of the class: kl. 0.5 - 30 VA; kl. 1 - 45 VA; kl. 3 - 50 VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-124

LCTB 140 - BUSBAR SERIES



INPUT:

200 A
...
5000 A

OUTPUTS:


5 A 1 A




	LCTB 140/80 (45)	LCTB 140/100H (45)	LCTB 140/100V (45)	LCTB 140/130V (45)
Hole diameter	Ø 72 mm	Ø 86 mm	Ø 86 mm	-
Busbar	80 x 30 mm, 2 x 60 x 25 mm	100 x 30 mm, 2 x 80 x 25 mm, 2 x 70 x 30 mm	100 x 30 mm, 2 x 80 x 25 mm, 2 x 70 x 30 mm	70 x 130 mm
Depth	45 mm	45 mm	45 mm	45 mm
Width	140 mm	140 mm	140 mm	140 mm
Primary current	200 A...2000 A	200 A...4000 A	200 A...3000 A	400 A...5000 A
Secondary current			1 A, 5 A	
Accuracy class			0.2S; 0.2; 0.5S; 0.5; 1	0.2; 0.5; 1

DIMENSIONS

LCTB 140/80 (45)

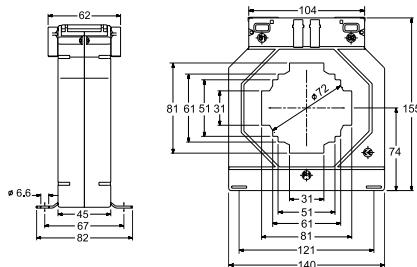


LCTB 140/100H (45)

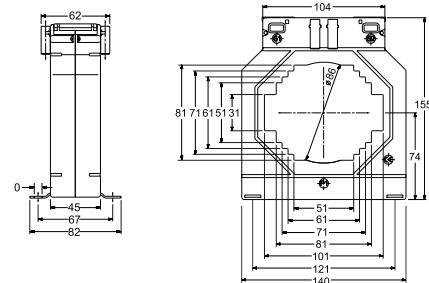


ORDERING CODES

LCTB 140804

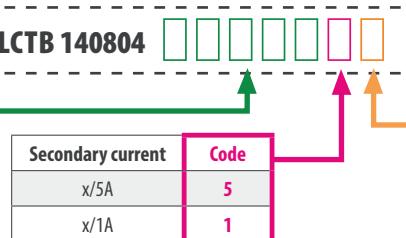

LCTB 14010H

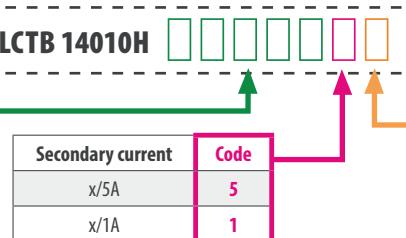

Transformer type	LCTB 140/80 (45)						
	Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-	
Code	Rated primary current	Transformer burden					
0200A	200 A	-	-	-	2.5 VA	5 VA	7.5 VA
0250A	250 A	-	-	-	5 VA	10 VA	12.5 VA
0300A	300 A	-	1.5 VA	-	7.5 VA	15 VA	15 VA
0400A	400 A	-	2.5 VA	-	10 VA	20 VA	25 VA
0500A	500 A	2.5 VA	5 VA	2.5 VA	15 VA	30 VA	30 VA
0600A	600 A	3.75 VA	7.5 VA	3.75 VA	15 VA	30 VA	35 VA
0750A	750 A	5 VA	10 VA	5 VA	15 VA	45 VA	45 VA
0800A	800 A	5 VA	10 VA	5 VA	15 VA	45 VA	50 VA
1000A	1000 A	10 VA	15 VA	10 VA	30 VA	60 VA	60 VA
1200A	1200 A	12.5 VA	15 VA	12.5 VA	30 VA	60 VA	60 VA
1250A	1250 A	12.5 VA	30 VA	12.5 VA	60 VA	60 VA	60 VA
1500A	1500 A	15 VA	30 VA	15 VA	60 VA	60 VA	60 VA
1600A	1600 A	15 VA	30 VA	15 VA	60 VA	60 VA	60 VA
2000A	2000 A	15 VA	30 VA	15 VA	60 VA	60 VA	60 VA

Code

Code

5

Transformer type	LCTB 140/100H (45)						
	Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-	
Code	Rated primary current	Transformer burden					
0200A	200 A	-	-	-	1.5 VA	3.75 VA	5 VA
0250A	250 A	-	-	-	2.5 VA	5 VA	7.5 VA
0300A	300 A	-	-	-	3.75 VA	7.5 VA	10 VA
0400A	400 A	-	1.5 VA	-	7.5 VA	10 VA	12.5 VA
0500A	500 A	-	2.5 VA	-	10 VA	12.5 VA	12.5 VA
0600A	600 A	2.5 VA	3.75 VA	2.5 VA	10 VA	15 VA	15 VA
0750A	750 A	5 VA	5 VA	5 VA	15 VA	20 VA	20 VA
0800A	800 A	5 VA	5 VA	5 VA	15 VA	20 VA	25 VA
1000A	1000 A	5 VA	10 VA	5 VA	15 VA	20 VA	25 VA
1200A	1200 A	10 VA	15 VA	10 VA	15 VA	30 VA	30 VA
1250A	1250 A	10 VA	15 VA	10 VA	15 VA	30 VA	35 VA
1500A	1500 A	15 VA	20 VA	15 VA	20 VA	30 VA	40 VA
1600A	1600 A	15 VA	20 VA	15 VA	20 VA	45 VA	45 VA
2000A	2000 A	15 VA	30 VA	15 VA	45 VA	45 VA	45 VA
2500A	2500 A	15 VA	30 VA	15 VA	45 VA	45 VA	45 VA
3000A	3000 A	15 VA	30 VA	15 VA	60 VA	60 VA	60 VA
4000A	4000 A	15 VA	30 VA	15 VA	60 VA	60 VA	60 VA

Code

Code


5

Ordering example: Order code LCTB 1408041500A55 means the transformer LCTB 140/80(45) 1500/5A meeting the requirements of the class: kl. 0.5 - 60 VA; kl. 1 - 60 VA; kl. 3 - 60 VA


LCTB 140 - BUSBAR SERIES

DIMENSIONS

LCTB 140/100V (45)

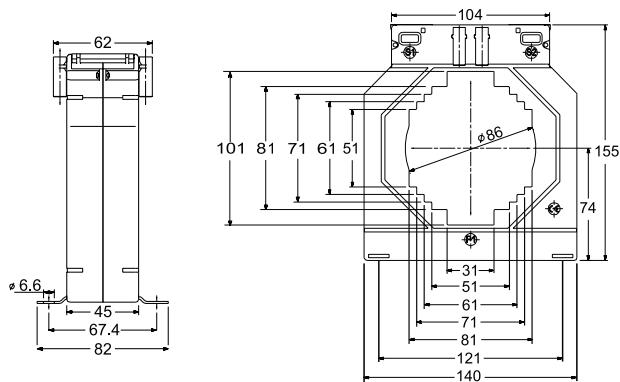


LCTB 140/130V (45)

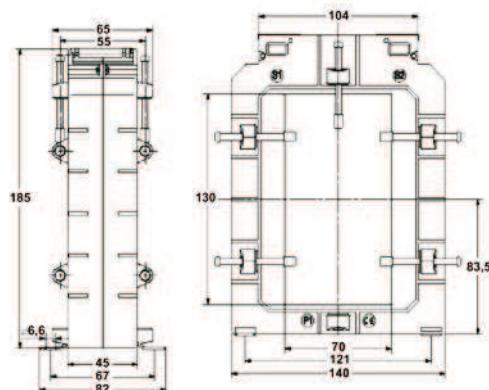

ORDERING CODES

LCTB 14010V



Secondary current	Code
x/5A	5
x/1A	1

LCTB 140/100V (45)

Transformer type	LCTB 140/100V (45)					
Accuracy class	0.2S	0.2	0.5S	0.5	1	3
Code	S	2	R	-	-	-

Code	Rated primary current	Transformer burden						Code
0200A	200 A	-	-	-	1.5 VA	3.75 VA	5 VA	
0250A	250 A	-	-	-	2.5 VA	5 VA	5 VA	
0300A	300 A	-	-	-	3.75 VA	7.5 VA	10 VA	
0400A	400 A	-	1.5 VA	-	10 VA	10 VA	12.5 VA	
0500A	500 A	-	2.5 VA	-	10 VA	12.5 VA	12.5 VA	
0600A	600 A	2.5VA	3.75 VA	2.5 VA	12.5 VA	15 VA	15 VA	
0750A	750 A	5 VA	5 VA	5 VA	15 VA	20 VA	20 VA	
0800A	800 A	5 VA	5 VA	5 VA	15 VA	20 VA	20 VA	
1000A	1000 A	5 VA	10 VA	5 VA	15 VA	20 VA	20 VA	
1200A	1200 A	10 VA	15VA	10 VA	15 VA	30 VA	30 VA	
1250A	1250 A	10 VA	15VA	10 VA	15 VA	30 VA	30 VA	
1500A	1500 A	15VA	20 VA	15 VA	30 VA	30 VA	35 VA	
1600A	1600 A	15VA	20 VA	15 VA	45 VA	45 VA	45 VA	
2000A	2000 A	15VA	30 VA	15 VA	45 VA	45 VA	45 VA	
2500A	2500 A	15VA	30VA	15 VA	45 VA	45VA	45 VA	
3000A	3000 A	15VA	30 VA	15 VA	60 VA	60 VA	60 VA	

LCTB 140130



Secondary current

x/5A	5
x/1A	1

Transformer type

LCTB 140/130V (45)

Transformer type	LCTB 140/130V (45)			
Accuracy class	0.2	0.5	1	3
Code	2	-	-	-

Code	Rated primary current	Transformer burden				Code
0400A	400 A	-	3.75 VA	5 VA	6.25 VA	
0500A	500 A	-	3.75 VA	5VA	7.5VA	
0600A	600 A	-	3.75 VA	5 VA	7.5 VA	
0750A	750 A	-	5 VA	7.5 VA	10 VA	
0800A	800 A	-	5 VA	7.5 VA	10 VA	
1000A	1000 A	5 VA	10 VA	10 VA	15 VA	
1200A	1200 A	7.5 VA	10 VA	15 VA	20 VA	
1250A	1250 A	7.5 VA	10 VA	15 VA	20 VA	
1500A	1500 A	10 VA	15 VA	15 VA	20 VA	
1600A	1600 A	10 VA	15 VA	15 VA	20 VA	
2000A	2000 A	15 VA	20 VA	20 VA	20 VA	
2500A	2500 A	15 VA	20 VA	20 VA	25 VA	
3000A	3000 A	15 VA	20 VA	20 VA	25 VA	
4000A	4000 A	15 VA	20 VA	20 VA	35 VA	
5000A	5000 A	15 VA	20 VA	20 VA	35 VA	

Ordering example: Order code LCTB 14010V1000A55 means the transformer LCTB 140/100V(45) 1000/5A meeting the requirements of the class:

- kl. 0.5 15VA
- kl. 1 20 VA
- kl. 3 20 VA

LCTB 225 - BUSBAR SERIES



INPUT:

600 A
...
7500 A

OUTPUTS:


5 A 1 A

CE


	LCTB 225/125 (50)	LCTB 225/167 (50)
Busbar	124 x 93 mm	166 x 65 mm
Depth	50 mm	50 mm
Width	225 mm	225 mm
Primary current	600 A...6000 A	1000 A...7500 A
Secondary current	1 A, 5 A	1 A, 5 A
Accuracy class	0.25; 0.2; 0.5S; 0.5; 1; 3	0.25; 0.2; 0.5S; 0.5; 1; 3

DIMENSIONS

LCTB 225/125 (50)

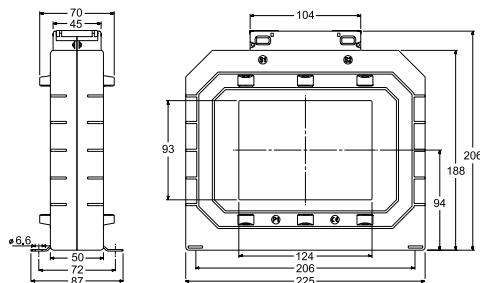

LCTB 225/167 (50)

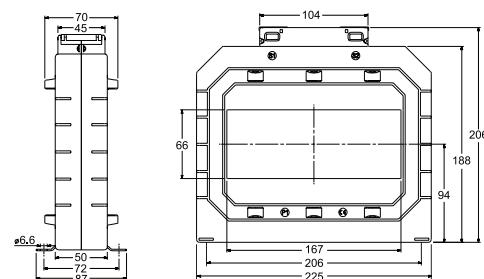

ORDERING CODES

LCTB 225125

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 225/125 (50)					
	Accuracy class	0.2S	0.2	0.5S	0.5	1
Code	S	2	R	-	-	-

Code	Rated primary current	Transformer burden						Code
		5 VA	10 VA	12.5 VA	15 VA	20 VA	30 VA	
0600A	600 A	-	5 VA	-	5 VA	10 VA	12.5 VA	
0750A	750 A	-	5 VA	-	10 VA	10 VA	12.5 VA	
0800A	800 A	-	5 VA	-	10 VA	10 VA	15 VA	
1000A	1000 A	5 VA	10 VA	5 VA	10 VA	15 VA	15 VA	
1200A	1200 A	5 VA	10 VA	5 VA	10 VA	15 VA	20 VA	
1250A	1250 A	5 VA	10 VA	5 VA	10 VA	15 VA	20 VA	
1500A	1500 A	7.5 VA	10 VA	7.5 VA	15 VA	30 VA	30 VA	
1600A	1600 A	7.5 VA	10 VA	7.5 VA	15 VA	30 VA	35 VA	
2000A	2000 A	10 VA	10 VA	10 VA	15 VA	30 VA	35 VA	
2500A	2500 A	10 VA	15 VA	10 VA	30 VA	30 VA	45 VA	
3000A	3000 A	10 VA	15 VA	10 VA	30 VA	60 VA	60 VA	
4000A	4000 A	15 VA	30 VA	15 VA	45 VA	60 VA	60 VA	
5000A	5000 A	15VA	30 VA	15 VA	100 VA	100 VA	100 VA	
6000A	6000 A	15 VA	60 VA	15 VA	100 VA	100 VA	100 VA	

LCTB 225167

Secondary current	Code
x/5A	5
x/1A	1

Transformer type	LCTB 225/167 (50)					
	Accuracy class	0.2S	0.2	0.5S	0.5	1
Code	S	2	R	-	-	-

Code

5

Ordering example: Order code LCTB 2251251500A55 means the transformer LCTB 225/125(50) 1500/5A meeting the requirements of the class: kl. 0.5 - 15 VA; kl. 1 - 30 VA ; kl. 3 - 30 VA

SERIA LCTS - SPLIT CORE SERIES

	LCTS 93/30SC(40)	LCTS 125/50SC (40)	LCTS 155/80SC(40)	LCTS 195/80SC (64)
Window dimensions	23 x 33 mm	85 x 54 mm	85 x 125 mm	82 x 162 mm
Depth	40 mm	40 mm	40 mm	64 mm
Width	93 mm	125 mm	155 mm	195 mm
Rated primary current	100 A...400 A	250 A...1000 A	250 A...3000 A	500 A...5000 A
Secondary current		1 A, 5 A		
Accuracy class		0.5; 1		

INPUT:

100 A
...
5000 A




OUTPUTS:

5 A 1 A




DIMENSIONS

LCTS 93/30SC (40)

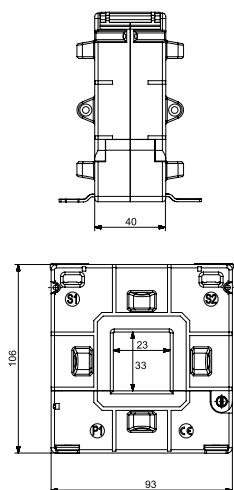


LCTS 125/50SC, 155/80SC, 195/80SC

side view



Side view (dimensions in mm)					
Type	a'	b'	c'	d'	e'
125/50SC (40)	60	50	40	65	80
155/80SC (40)	60	50	40	65	80
195/80SC (64)	84	74	64	80	100

front view



Front view (dimensions in mm)					
Type	a	b	c	d	e
125/50SC (40)	54	158	85	106	125
155/80SC (40)	85	198	125	136	155
195/80SC (64)	80	245	160	179	195

ORDERING CODES

Transformer type	LCTS 93/30SC (40)		LCTS 125/50SC (40)		LCTS 155/80SC (40)		LCTS 195/80SC (64)	
	Accuracy class		0.5	1	0.5	1	0.5	1
	Code		5	1	5	1	5	1
Code	Primary current	Transformer burden						
0100A	100 A	-	1.5 VA	-	-	-	-	-
0150A	150 A	-	1.75 VA	-	-	-	-	-
0200A	200 A	-	2.5 VA	-	-	-	-	-
0250A	250 A	-	3.75 VA	1 VA	2.5 VA	1 VA	2.5 VA	-
0300A	300 A	2.5 VA	5 VA	2.5 VA	3.75 VA	1.5 VA	3.75 VA	-
0400A	400 A	3.75 VA	6.25 VA	2.5 VA	3.75 VA	2.5 VA	3.75 VA	-
0500A	500 A	-	-	3.75 VA	5 VA	3.75 VA	5 VA	1.25 VA
0600A	600 A	-	-	5 VA	7.5 VA	5 VA	7.5 VA	1.25 VA
0750A	750 A	-	-	7.5 VA	10 VA	7.5 VA	10 VA	5 VA
0800A	800 A	-	-	7.5 VA	10 VA	7.5 VA	10 VA	10 VA
1000A	1000 A	-	-	10 VA	15 VA	10 VA	15 VA	20 VA
1200A	1200 A	-	-	-	15 VA	30 VA	15 VA	20 VA
1250A	1250 A	-	-	-	15 VA	30 VA	15 VA	20 VA
1500A	1500 A	-	-	-	20 VA	45 VA	20 VA	30 VA
1600A	1600 A	-	-	-	20 VA	45 VA	20 VA	30 VA
2000A	2000 A	-	-	-	20 VA	45 VA	25 VA	30 VA
2500A	2500 A	-	-	-	25 VA	45 VA	25 VA	30 VA
3000A	3000 A	-	-	-	30 VA	45 VA	30 VA	45 VA
4000A	4000 A	-	-	-	-	30 VA	45 VA	-
5000A	5000 A	-	-	-	-	30 VA	45 VA	-

LCTS 933040

LCTS 125504

LCTS 155804

LCTS 195806

Secondary current	Code
x/5A	5
x/1A	1

Ordering example: Order code LCTS 933040300A55 means the transformer LCTS 93/30SC(40) 300/5A ; Class 0.5; power 2.5VA

LCTP - 3-PHASE BUSBAR SERIES



INPUT:

100 A
...
500 A


OUTPUT:

5 A 1 A


	LCTP 75/15 (60)	LCTP 105/21 (40)	LCTP 140/31 (40)
Busbar	14 x 24 mm	20 x 24 mm	31 x 36 mm
Depth	60 mm	40 mm	40 mm
Width	76.5 mm	105 mm	140 mm
Primary current	100...160 A	100...250 A	250...630 A
Secondary current		5 A; 1 A	
Accuracy class		0.5; 1	

DIMENSIONS





LCTP 75/15 (60)

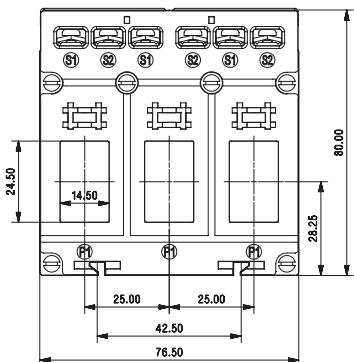

LCTP 105/21 (40)

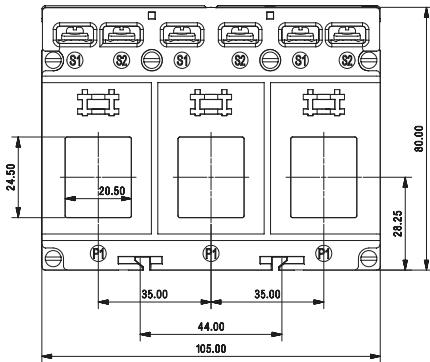

LCTP 140/31 (40)

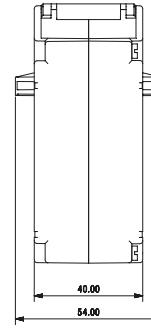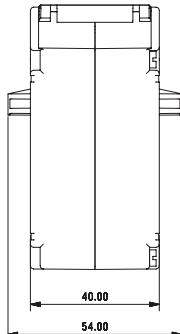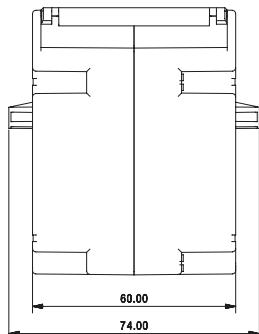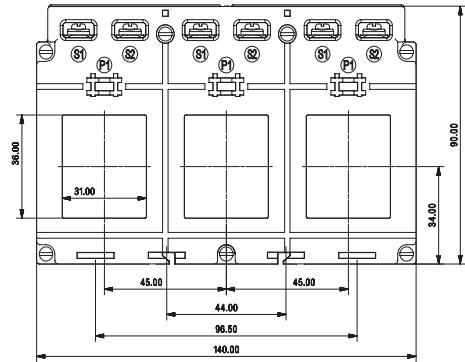

ORDERING CODES

	Transformer type	LCTP 75/15 (60)		LCTP 105/21 (40)		LCTP 140/31 (40)	
Code	Accuracy class	0.5	1	0.5	1	0.5	1
Code	Primary current	Transformer burden					
0100A	100 A	-	1 VA	-	1 VA	-	-
0125A	125 A	-	1.5 VA	-	1.5 VA	-	-
0150A	150 A	1.5 VA	1.5 VA	-	1.5 VA	-	-
0160A	160 A	1.5 VA	1.5 VA	1.5 VA	1.5 VA	-	-
0200A	200 A	-	-	1.5 VA	1.5 VA	-	-
0250A	250 A	-	-	1.5 VA	1.5 VA	1.5 VA	-
0300A	300 A	-	-	-	-	2.5 VA	2.5 VA
0400A	400 A	-	-	-	-	2.5 VA	2.5 VA
0500A	500 A	-	-	-	-	2.5 VA	2.5 VA
0600A	600 A	-	-	-	-	2.5 VA	2.5 VA
0630A	630 A	-	-	-	-	2.5 VA	2.5 VA

Secondary current	Code
x/5A	5
x/1A	1

LCTP 751560 □ □ □ □ □ □

LCTP 105214 □ □ □ □ □ □

LCTP 140314 □ □ □ □ □ □

Ordering example: Order code LCTP 7515600150A55 means the transformer LCTP 75/15(60) 150/5A; Class 0.5; power 1.5VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-124

32

www.lumel.com.pl

LCTP - 3-PHASE BUSBAR SERIES

	LCTP 185/27 (45)	LCTP 185/37 (45)
Hole diameter	Ø 27 mm	Ø 37 mm
Depth	45 mm	45 mm
Width	185 mm	185 mm
Primary current	100...500 A	300...800 A
Secondary current	5A; 1A	
Accuracy class	1	

INPUT:

100 A
...
800 A




OUTPUT:

5 A 1 A






DIMENSIONS

LCTP 185/27 (45)

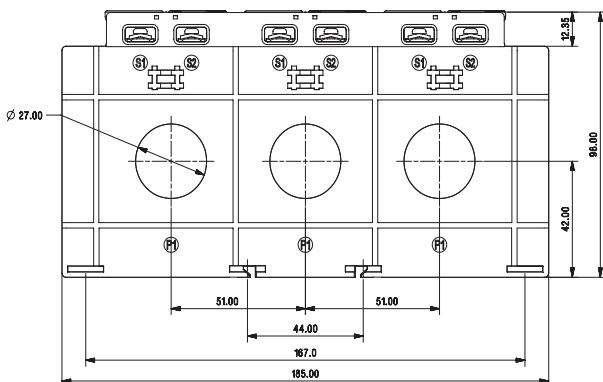

LCTP 185/37 (45)

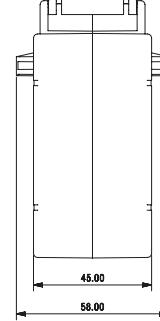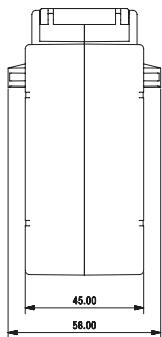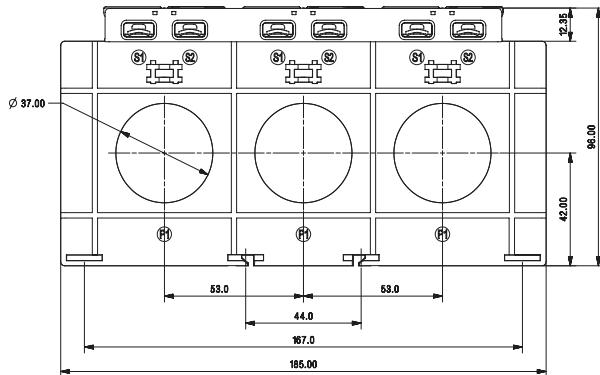

ORDERING CODES

	LCTP 185/27 (45)	LCTP 185/37 (45)
Accuracy class	1	1
Code	1	1
Code	Primary current	Transformer burden
0100A	100 A	1.5 VA
0150A	150 A	1.5 VA
0200A	200 A	2.5 VA
0250A	250 A	2.5 VA
0300A	300 A	5 VA
0400A	400 A	5 VA
0500A	500 A	5 VA
0600A	600 A	-
0800A	800 A	-

Secondary current	Code
x/5A	5
x/1A	1

LCTP 185274

LCTP 185374

Ordering example: Order code LCTP 1852740150A51 means the transformer LCTP 185/27(45) 150/5A; Class 1; power 1.5VA

ACCESSORIES:

DIN rail mounting base

Order code: LH000-0904-130-124

LRC- RESIN CAST SERIES



INPUT:

60 A
...
320 A


OUTPUT:

5 A 1 A


	LRC1 80/30(50)	LRC2 90/50(40)
Hole diameter	Ø 30 mm	Ø 50 mm
Depth	50 mm	40 mm
Width	80 mm	90 mm
Primary current	60 A...160 A	200 A...320 A
Secondary current		1 A, 5 A
Accuracy class		1

DIMENSIONS

LRC1 80/30(50)

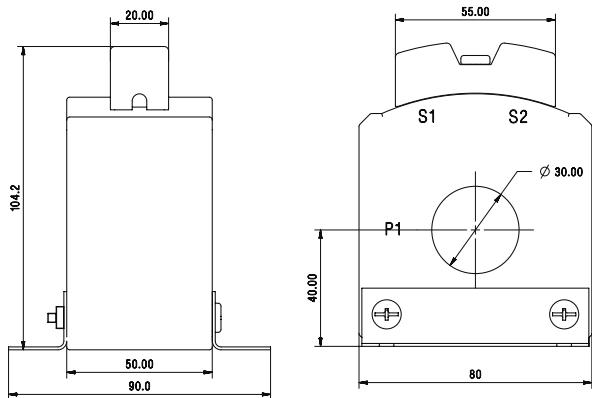

LRC2 90/50(40)

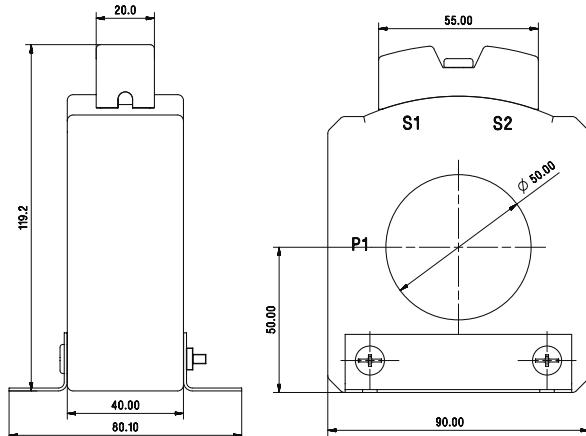

ORDERING CODES

Transformer type	LRC1 80/30(50)	LRC2 90/50(40)
Accuracy class	1	1
Code	1	1
Code	Primary current	Transformer burden
0060A	60 A	1.5 VA
0100A	100 A	5 VA
0125A	125 A	5 VA
0150A	150 A	5 VA
0160A	160 A	5 VA
0200A	200 A	-
0250A	250 A	-
0300A	300 A	-
0320A	320 A	-

Secondary current	Code
x/5A	5
x/1A	1

LRC1 803050 LRC2 905040

Ordering example: Order code LRC1 8030500150A51 means the transformer LRC1 80/30(50) 150/5A; Class 1; power 5VA

LRC- RESIN CAST SERIES

	LRC3 110/72(40)	LRC4 135/85(40)
Hole diameter	Ø 72 mm	Ø 85 mm
Depth	40 mm	40 mm
Width	110 mm	135 mm
Primary current	400 A...630 A	800 A...1250 A
Secondary current	1 A, 5 A	
Accuracy class	1	

INPUT:

400 A
...
1250 A



OUTPUTS:


5 A

1 A




DIMENSIONS

LRC3 110/72(40)

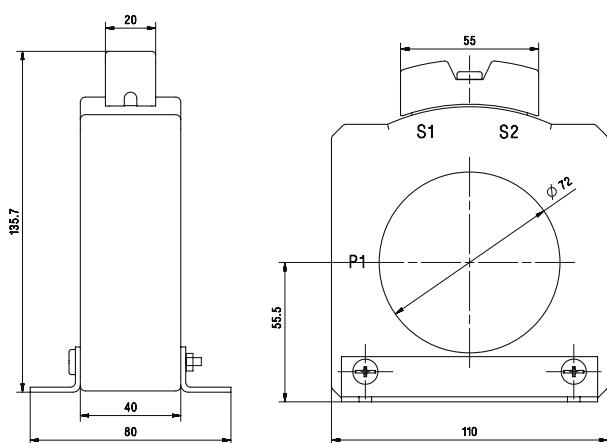

LRC4 135/85(40)

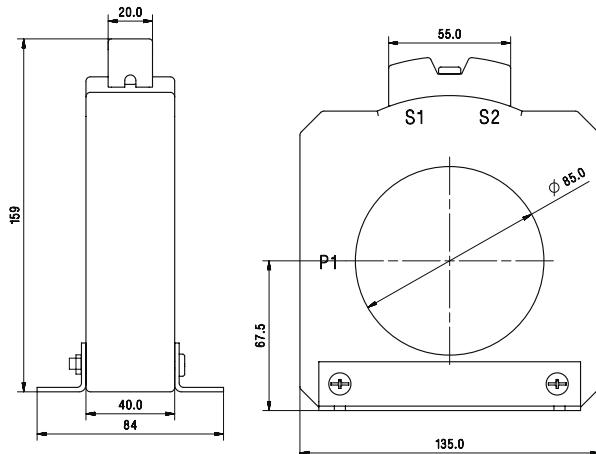

ORDERING CODES

Transformer type	LRC3 110/72(40)	LRC4 135/85(40)
Accuracy class	1	1
Code	1	1
Code	Primary current	Transformer burden
0400A	400 A	10 VA
0500A	500 A	15 VA
0600A	600 A	15 VA
0630A	630 A	15 VA
0800A	800 A	-
1000A	1000 A	-
1200A	1200 A	-
1250A	1250 A	-

Secondary current	Code
x/5A	5
x/1A	1

LCR3 110724

LCR4 135854

Ordering example: Order code LRC3 1107240500A51 means the transformer LRC3 110/72(40) 500/5A; Class 1; power 15VA

LRC- RESIN CAST SERIES



INPUT:

1500 A
...
3200 A


OUTPUTS:

5 A 1 A


	LRC5 165/115(40)	LRC6 195/130(40)
Hole diameter	Ø 115 mm	Ø 130 mm
Depth	40 mm	40 mm
Width	165 mm	195 mm
Primary current	1500 A...2000 A	2500 A...3200 A
Secondary current	1 A, 5 A	
Accuracy class	1	

DIMENSIONS

LRC5 165/115(40)

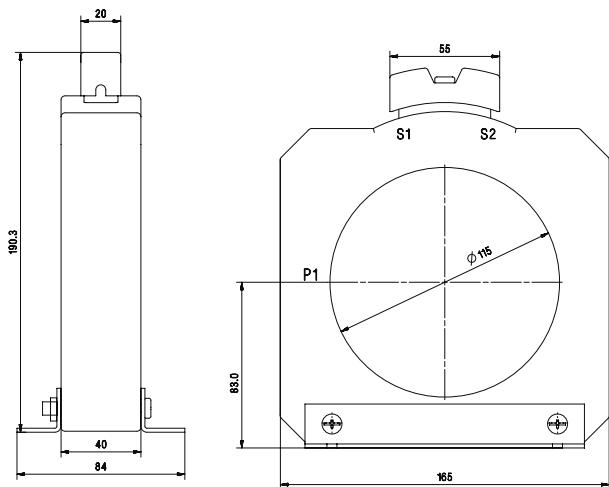

LRC6 195/130(40)

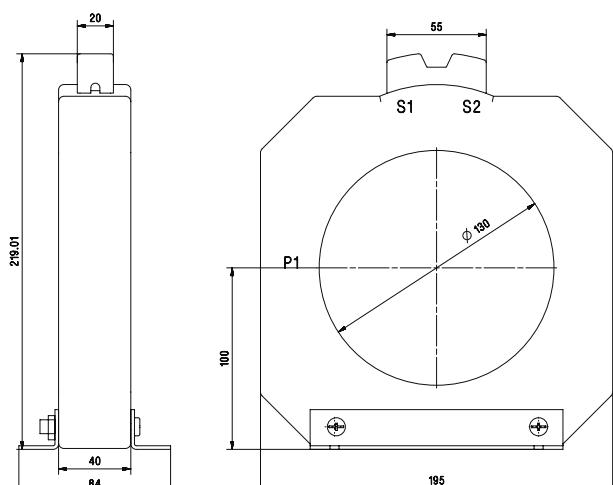

ORDERING CODES

Transformer type	LRC5 165/115(40)	LRC6 195/130(40)
Accuracy class	1	1
Code	1	1
Code	Primary current	Transformer burden
1500A	1500 A	15 VA
1600A	1600 A	15 VA
2000A	2000 A	15 VA
2500A	2500 A	-
3000A	3000 A	-
3200A	3200 A	-

Secondary current	Code
x/5A	5
x/1A	1



Ordering example: Order code LRC5 1651151500A51 means the transformer LRC5 165/115(40) 1500/5A; Class 1; power 15VA

	LRC7 230/165(40)	LRC8 295/200(40)
Hole diameter	Ø 165 mm	Ø 200 mm
Depth	40 mm	40 mm
Width	230 mm	295 mm
Primary current	3000 A...3200 A	4000 A....5000 A
Secondary current	1 A, 5 A	
Accuracy class	1	

INPUT:

3000 A
...
5000 A




OUTPUTS:

5 A


1 A

DIMENSIONS

LRC7 230/165(40)

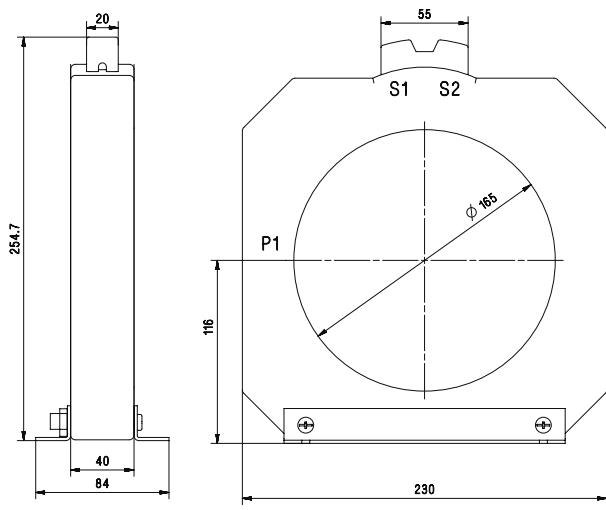

LRC8 295/200(40)

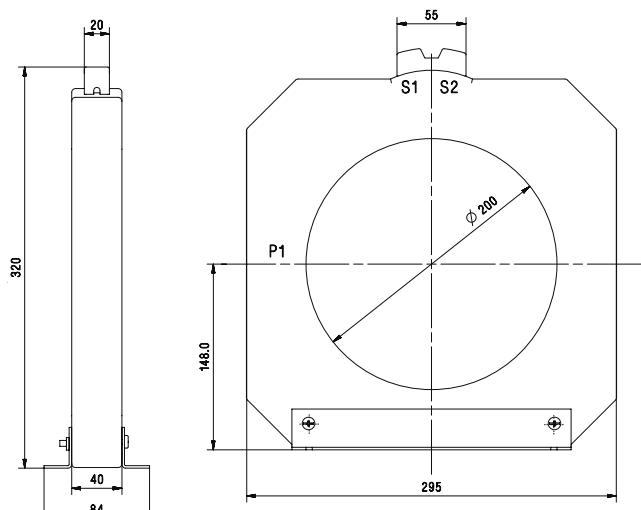

ORDERING CODES

	LRC7 230/165(40)	LRC8 295/200(40)
Accuracy class	1	1
Code	1	1
Code	Primary current	Transformer burden
3000A	3000 A	15 VA
3200A	3200 A	15 VA
4000A	4000 A	-
5000A	5000 A	15 VA

Secondary current	Code
x/5A	5
x/1A	1


LRC7 230165 □ □ □ □ □ □

LRC8 295200 □ □ □ □ □ □ □

Ordering example: Order code LRC7 2301653200A51 means the transformer LRC7 230/165(40) 3200/5A; Class 1; power 15VA

LU01 - SUMMATION CURRENT TRANSFORMERS

SUMMATION CURRENT TRANSFORMER are designed to summarize several synchronous alternating currents of equal phase relation with any angle of phase difference. They are used to add secondary currents of several main c.t.s in order to measure with the CT only.

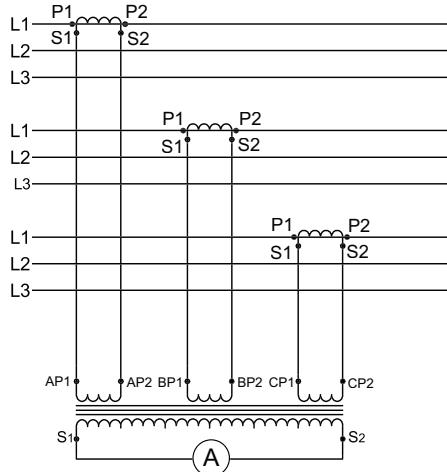

Current measurement in phase L1

AN EXAMPLE OF POWER SELECTION FOR MAIN TRANSFORMERS WITH DIFFERENT TRANSMISSIONS

Main Transformer ratio:

$$\begin{array}{r}
 500/5A \\
 400/5A \\
 300/5A \\
 \hline
 \text{Total current} = 1200/5A
 \end{array}$$

Burden - 1 Ammeter

Required Active performance of the Current Transformer:

Ammeter	1.5 VA
Measurement Conductor Loss	1.5 VA
Consumption in Summation CT	4.0 VA
Total VA	7.0 VA

The individual main transformer must provide its VA share from this 7.0 VA.

1. Main transformer 500/5A $(500/1200) \times 7 = 2.92 \text{ VA} + \text{additional losses} \approx 3.75 \text{ VA}^*$
2. Main transformer 400/5A $(400/1200) \times 7 = 2.33 \text{ VA} + \text{additional losses} \approx 2.5 \text{ VA}^*$
3. Main transformer 300/5A $(300/1200) \times 7 = 1.75 \text{ VA} + \text{additional losses} \approx 2.5 \text{ VA}^*$

*The VA values of the main transformer are to be rounded up to the corresponding values in our chart.

Note: If using unequal main c.t.'s than ration of lowest primary main c.t. current to the highest one should not exceed 1:8.

FEATURES:

- Available current transformers versions with 2 to 8 primary windings.
- Nickel plated secondary terminals with +/- screws.
- Multiple mounting methods, including wall mounting, DIN rail 35mm.
- Terminal protection IP10.

GENERAL SPECIFICATION

Applicable standard:

IEC 61869-1/2

Case:

self-extinguishing plastic

Connection:

Two connection on each side. M4 screws with self lifting clamp strap.

Insulation class:

E (max 120°C)

Maximum system voltage:

0.72 kV

Operating frequency:

50/60 Hz

Test voltage:

3 kV, 50 Hz, 1 min

Rated primary rating:

(2...8) x 5A

Rated secondary output:

5A

Rated burden:

5; 10; 15; 20; 25 VA

Accuracy class:

0.5; 1

Ambient temperature:

-25°C ...+40°C

Storage temperature:

-50°C...+80°C

Thermal short circuit current (I_{th}):

$60 \times I_n$

Dynamic short circuit current (I_{dyn}):

$2.5 \times I_{th}$

Instrument security factor (FS):

5,10

FEATURES:

720 V **Class 0.5 1**

OUTPUTS:

5 A

LU01- SUMMATION CURRENT TRANSFORMERS

LU01 (75)	
Depth	70 mm
Width	75 mm
Inputs	2 x 1 A...4 x 1 A or 2 x 5 A...4 x 5 A
Secondary current	1 A, 5 A
Accuracy class	0.5; 1

INPUTS:

2 x 1A
...
4 x 1A

2 x 5A
...
4 x 5A




OUTPUTS:

1 A 5 A



DIMENSIONS

LU01 (75)

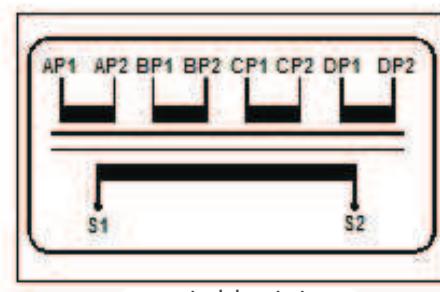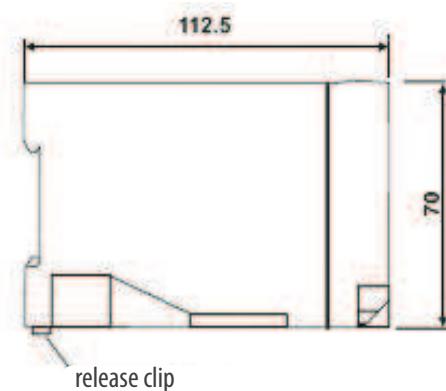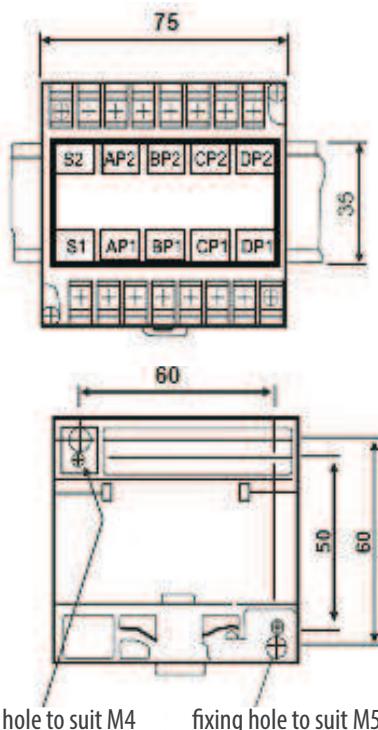

terminal description

ORDERING CODES

Transformer type		LU01 (75)	
Accuracy class	0.5	1	
Code	5	1	
Code	Inputs	Transformer burden	
		5 VA	5 VA
		10 VA	10 VA
		15 VA	15 VA
		-	20 VA
02	2 x 5A	-	25 VA
		5 VA	5 VA
		10 VA	10 VA
		15 VA	15 VA
		-	20 VA
03	3 x 5A	-	25 VA
		5 VA	5 VA
		10 VA	10 VA
		15 VA	15 VA
		-	20 VA
04	4 x 5A	-	25 VA
		5 VA	5 VA
		10 VA	10 VA
		15 VA	15 VA
		-	20 VA
		-	25 VA
		08	
		11	
		13	
		14	
		17	
		08	
		11	
		13	
		14	
		17	
		08	
		11	
		13	
		14	
		17	
Primary currents		Secondary current	Code
(2...4) x 1 A		x / 1 A	11
(2...4) x 5 A		x / 5 A	55

Ordering example: Order code LU01 0255111L00000 means the summation transformer LU01 (75), INPUTS: 2x 5A, Class 1, 10 VA

LU01 - SUMMATION CURRENT TRANSFORMERS



INPUTS:

5 x 1A
...
8 x 1A


5 x 5A
...
8 x 5A

OUTPUTS:



1 A 5 A

LU01 (150)

LU01 (150)

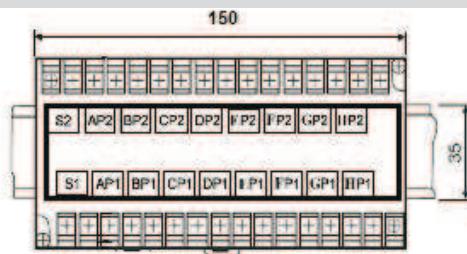

DIMENSIONS

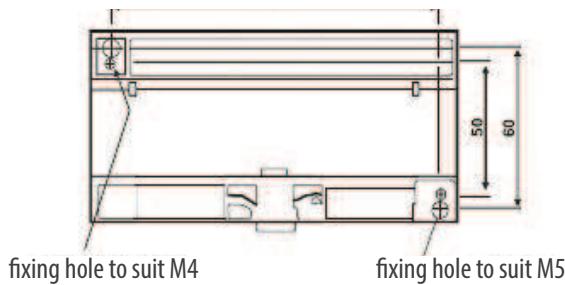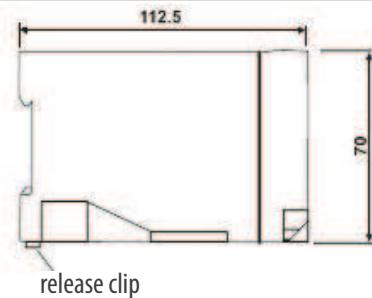

terminal description

ORDERING CODES

Transformer type		LU01 (150)		Code	Code	Code	LU01	L00000
Accuracy class		0.5	1					
05	Inputs	5 x 5A	5 VA	08				
			10 VA	11				
			15 VA	13				
			-	14				
			20 VA	17				
			25 VA	08				
06	Inputs	6 x 5A	5 VA	11				
			10 VA	11				
			15 VA	13				
			-	14				
			20 VA	17				
			25 VA	08				
07	Inputs	7 x 5A	5 VA	08				
			10 VA	11				
			15 VA	13				
			-	14				
			20 VA	17				
			25 VA	08				
08	Inputs	8 x 5A	5 VA	11				
			10 VA	11				
			15 VA	13				
			-	14				
			20 VA	17				
			25 VA	08				

Ordering example: Order code LU01 0555111L00000 means the summation transformer LU01 (150), INPUTS: 5x 5A, Class 1, 10 VA

LW- ROUND CURRENT TRANSFORMERS

	LW01	LW02
Hole diameter	Ø 30 mm	Ø 30 mm
Depth	40 mm	50 mm
Outer diameter	Ø 73 mm	Ø 73 mm
Primary current	50 A...200 A	50 A...200 A
Secondary current	1 A, 5 A	
Accuracy class	0.5; 1	0.2; 0.5S; 0.5; 1

INPUT:

50 A
...
200 A


OUTPUTS:

5 A 1 A




DIMENSIONS

LW01

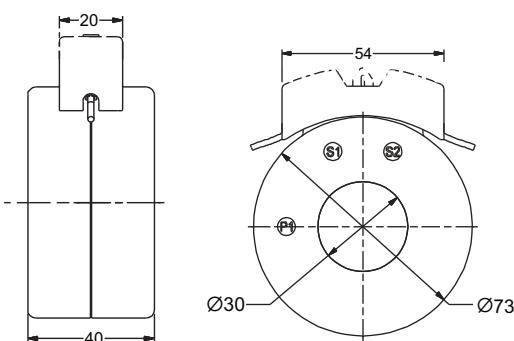


LW02

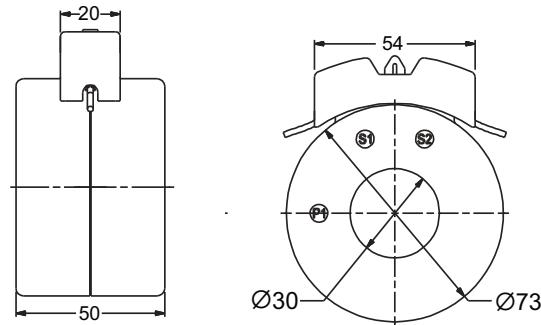

ORDERING CODES

Transformer type	LW01			LW02																							
	0.5	1	0.2	0.5S	0.5	1	0.5	1.5 VA	0.5	2.5 VA	0.5	5 VA	0.5	10 VA	0.5	15 VA	0.5	1.5 VA	0.5	2.5 VA	0.5	5 VA	0.5	10 VA	0.5	15 VA	0.5
Code	Rated primary current	Transformer burden																									
13	50 A	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-		
14	60 A	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-		
16	75 A	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-	1.5 VA	035	2.5 VA	051	-	-	-	-	-	-	-	-	
18	100 A	1.5 VA	035	2.5 VA	051	-	-	-	-	-	-	-	-	-	2.5 VA	055	5 VA	081	-	-	-	-	-	-	-	-	
19	120 A	1.5 VA	035	2.5 VA	051	-	-	-	-	-	-	-	-	-	2.5 VA	055	5 VA	081	-	-	-	-	-	-	-	-	
20	125 A	2.5 VA	055	3.75 VA	071	-	-	-	-	-	-	-	-	-	2.5 VA	055	5 VA	081	-	-	-	-	-	-	-	-	
22	150 A	2.5 VA	055	5 VA	081	-	-	2.5 VA	056	5 VA	085	10 VA	111	15 VA	131	-	-	-	-	-	-	-	-	-	-	-	-
24	200 A	5 VA	085	10 VA	111	2.5 VA	052	5 VA	086	10 VA	115	15 VA	131	-	-	-	-	-	-	-	-	-	-	-	-	-	-

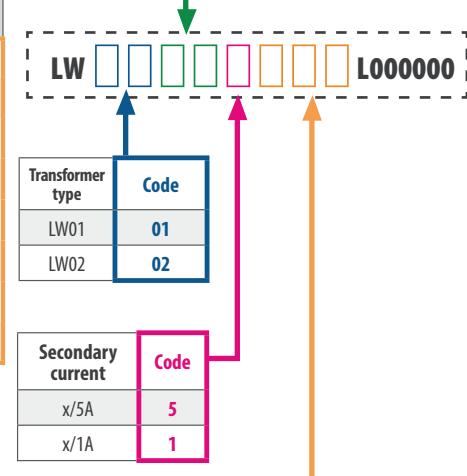

Ordering example: Order code LW 01185035L000000 means the transformer LW01 100/5A; Class 0.5; power 1.5VA

LW- ROUND CURRENT TRANSFORMERS



INPUT:

75 A
...
600 A

OUTPUTS:

5 A 1 A


LW03

LW04


Hole diameter	Ø 43 mm	Ø 58 mm
Depth	41 mm	41 mm
Outer diameter	Ø 92 mm	Ø 100 mm
Primary current	75 A...300 A	120 A...600 A
Secondary current	1 A, 5 A	
Accuracy class	0.2; 0.5S; 0.5; 1	

DIMENSIONS

LW03

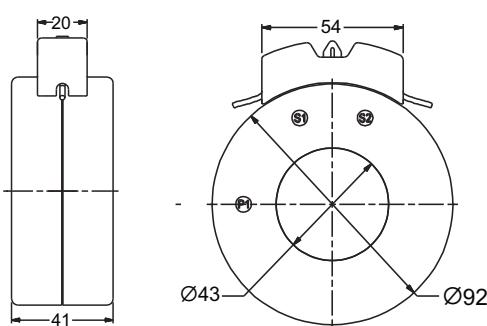


LW04

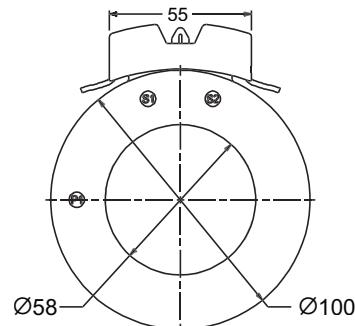

ORDERING CODES

Transformer type	LW03				LW04			
	0.2	0.5S	0.5	1	0.2	0.5S	0.5	1
Code	Rated primary current							
16	75 A	-	-	-	1 VA	011	-	-
17	80 A	-	-	-	1.5 VA	031	-	-
18	100A	-	-	-	1VA	015	2.5 VA	051
19	120A	-	-	-	1VA	015	2.5 VA	051
20	125 A	-	-	-	1VA	015	2.5 VA	051
22	150 A	-	-	-	1.5 VA	035	3.75 VA	071
24	200 A	1.5 VA	032	5 VA	086	5 VA	085	10 VA
27	250 A	2.5 VA	052	7.5 VA	106	7.5 VA	105	15 VA
28	300 A	3.75 VA	072	10 VA	116	10 VA	115	20 VA
31	400 A	-	-	-	-	-	5 VA	082
32	500 A	-	-	-	-	-	7.5 VA	102
33	600 A	-	-	-	-	-	10 VA	112

Code

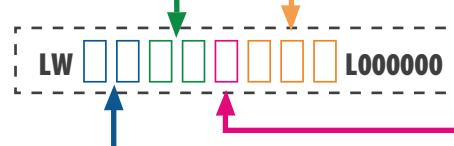

Transformer type	Code
LW03	03
LW04	04

Secondary current	Code
x/5A	5
x/1A	1

Ordering example: Order code LW 03185015L000000 means the transformer LW03 100/5A; Class 0.5; power 1VA

LW- ROUND CURRENT TRANSFORMERS

	LW05	LW06
Hole diameter	Ø 72 mm	Ø 113 mm
Depth	41 mm	40 mm
Outer diameter	Ø 110 mm	Ø 159 mm
Primary current	200 A...1000 A	600 A...3200 A
Secondary current	1 A, 5 A	
Accuracy class	0.2; 0.5S; 0.5; 1	

INPUT:

200 A
...
3200 A


OUTPUTS:

5 A 1 A




DIMENSIONS

LW05

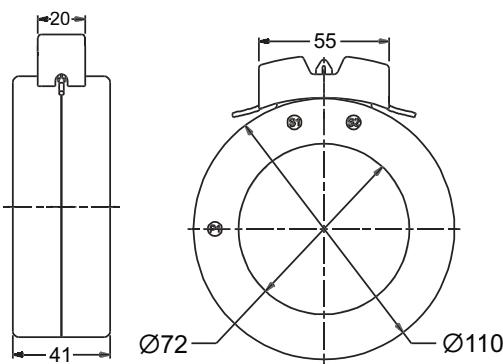

LW06

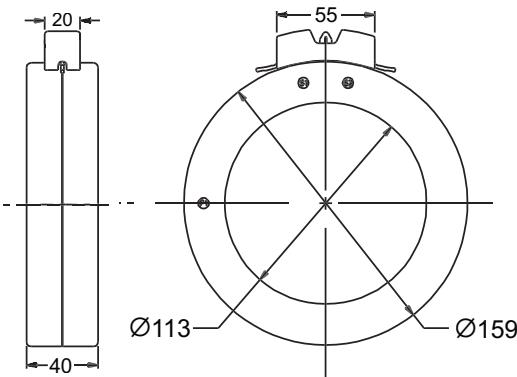

ORDERING CODES

Transformer type	LW05								LW06								
	0.2	0.5S	0.5	1	0.2	0.5S	0.5	1	0.2	0.5S	0.5	1	0.2	0.5S	0.5	1	
Code	Rated primary current																
24	200 A	-	-	-	-	-	1.5 VA	031	-	-	-	-	-	-	-	-	-
27	250 A	-	-	-	-	1.5 VA	035	2.5 VA	051	-	-	-	-	-	-	-	-
28	300 A	-	-	-	-	2.5 VA	055	5 VA	081	-	-	-	-	-	-	-	-
31	400 A	2.5 VA	052	5 VA	086	7.5 VA	105	12.5 VA	121	-	-	-	-	-	-	-	-
32	500 A	3.75 VA	072	7.5 VA	106	10 VA	115	15 VA	131	-	-	-	-	-	-	-	-
33	600 A	5 VA	082	7.5 VA	106	10 VA	115	15 VA	131	1.5 VA	032	3.75 VA	076	5 VA	085	10 VA	111
37	800 A	10 VA	112	15 VA	136	15 VA	135	30 VA	151	2.5 VA	052	7.5 VA	106	10 VA	115	15 VA	131
39	1000 A	10 VA	112	15 VA	136	15 VA	135	30 VA	151	3.75 VA	072	7.5 VA	106	10 VA	115	15 VA	131
40	1200 A	-	-	-	-	-	-	-	-	15 VA	132	15 VA	136	20 VA	145	30 VA	151
41	1250 A	-	-	-	-	-	-	-	-	15 VA	132	15 VA	136	20 VA	145	30 VA	151
42	1500 A	-	-	-	-	-	-	-	-	15 VA	132	15 VA	136	20 VA	145	30 VA	151
43	1600 A	-	-	-	-	-	-	-	-	15 VA	132	15 VA	136	20 VA	145	30 VA	151
44	2000 A	-	-	-	-	-	-	-	-	15 VA	132	20 VA	146	25 VA	205	45 VA	161
46	2500 A	-	-	-	-	-	-	-	-	15 VA	132	20 VA	146	25 VA	205	45 VA	161
48	3000 A	-	-	-	-	-	-	-	-	15 VA	132	25 VA	206	30 VA	155	45 VA	161
49	3200 A	-	-	-	-	-	-	-	-	15 VA	132	25 VA	206	30 VA	155	45 VA	161
Code																	
Transformer type Code LW05 05 LW06 06																	
Secondary current Code x/5A 5 x/1A 1																	

Ordering example: Order code LW 05285055L000000 means the transformer LW05 300/5A; Class 0.5; power 2.5VA

LE - ROUND CURRENT TRANSFORMERS



INPUT:

50 A
...
600 A


OUTPUTS:

5 A 1 A


	LE 73/30 (50)	LE 92/43 (41)	LE 95/50 (40)	LE 100/58 (41)
Hole diameter	Ø 30 mm	Ø 43 mm	Ø 50 mm	Ø 58 mm
Depth	50 mm	41 mm	40 mm	50 mm
Outer diameter	Ø 73 mm	Ø 92 mm	Ø 95 mm	Ø 73 mm
Primary current	50 A...200 A	200 A...400 A	200 A...300 A	400 A...600 A
Secondary current			1 A, 5 A	
Accuracy class	1; 5		1	

DIMENSIONS


LE 73/30 (50)




LE 92/43 (41)



LE 95/50 (40)



LE 100/58 (41)



ORDERING CODES

Transformer type	LE 73/30 (50)			LE 92/43 (41)			LE 95/50 (40)			LE 100/58 (41)																		
Accuracy class	1		5	1		1		1		1		1																
Code	Rated primary current	Transformer burden																										
13	50 A	-	-	-	-	5 VA	087	-	-	-	-	-																
14	60 A	-	-	-	-	5 VA	087	-	-	-	-	-																
16	75 A	-	-	-	-	5 VA	087	-	-	-	-	-																
18	100 A	5 VA	081	-	-	-	-	-	-	-	-	-																
22	150 A	5 VA	081	-	-	-	-	-	-	-	-	-																
24	200 A	5 VA	081	15	131	-	5 VA	081	10 VA	111	15 VA	131																
27	250 A	-	-	-	-	5 VA	081	10 VA	111	15 VA	131	-																
28	300 A	-	-	-	-	5 VA	081	10 VA	111	15 VA	131	-																
31	400 A	-	-	-	-	5 VA	081	-	15 VA	131	-	5 VA																
32	500 A	-	-	-	-	-	-	-	-	-	5 VA	081																
33	600 A	-	-	-	-	-	-	-	-	-	5 VA	081																
Code																												
LE [] [] [] [] [] [] L000000																												
<table border="1"> <tr> <td>Transformer type</td> <td>Code</td> </tr> <tr> <td>LE 73/30 (50)</td> <td>01</td> </tr> <tr> <td>LE 92/43 (41)</td> <td>03</td> </tr> <tr> <td>LE 95/50 (40)</td> <td>04</td> </tr> <tr> <td>LE 100/58 (41)</td> <td>05</td> </tr> </table>							Transformer type	Code	LE 73/30 (50)	01	LE 92/43 (41)	03	LE 95/50 (40)	04	LE 100/58 (41)	05	<table border="1"> <tr> <td>Secondary current</td> <td>Code</td> </tr> <tr> <td>x/5A</td> <td>5</td> </tr> <tr> <td>x/1A</td> <td>1</td> </tr> </table>						Secondary current	Code	x/5A	5	x/1A	1
Transformer type	Code																											
LE 73/30 (50)	01																											
LE 92/43 (41)	03																											
LE 95/50 (40)	04																											
LE 100/58 (41)	05																											
Secondary current	Code																											
x/5A	5																											
x/1A	1																											

Ordering example: Order code LE 01185081L000000 means the transformer LE 73/30(50) 100/5A; Class 1; power 5VA

LE - ROUND CURRENT TRANSFORMERS

INPUT:

800 A
...
5000 A




OUTPUTS:

5 A 1 A




DIMENSIONS


LE 110/72 (41)




LE 135/85 (30)



LE 159/113 (40)




LE 165/130 (30)

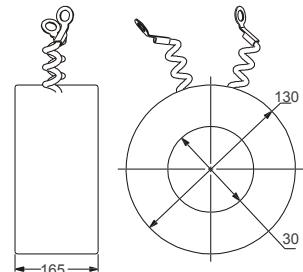

ORDERING CODES

Transformer type	LE 110/72 (41)		LE 135/85 (30)		LE 159/113 (40)		LE 165/130 (30)	
Accuracy class	1		1		1		1	
Code	Rated primary current	Transformer burden						
37	800 A	5 VA	081	15 VA	131	5 VA	081	15 VA
39	1000 A	5 VA	081	15 VA	131	5 VA	081	15 VA
40	1200 A	-	-	-	-	15 VA	131	-
42	1500 A	-	-	-	-	15 VA	131	-
43	1600 A	-	-	-	-	15 VA	131	-
44	2000 A	-	-	-	-	15 VA	131	-
45	2400 A	-	-	-	-	-	15 VA	131
46	2500 A	-	-	-	-	-	15 VA	131
48	3000 A	-	-	-	-	-	15 VA	131
51	4000 A	-	-	-	-	-	15 VA	131
52	5000 A	-	-	-	-	-	15 VA	131

Code

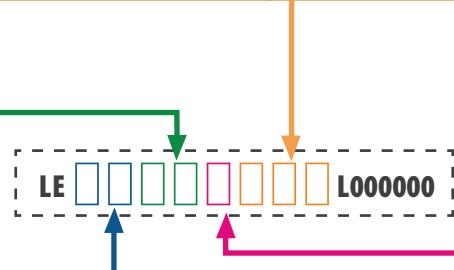


Transformer type	Code
LE 110/72 (41)	06
LE 135/85 (30)	07
LE 159/113 (41)	08
LE 165/130 (30)	09

Secondary current	Code
x/5A	5
x/1A	1

Ordering example: Order code LE 06395081L000000 means the transformer LE 110/72(41) 1000/5A; Class 1; power 5VA

ACCESSORIES

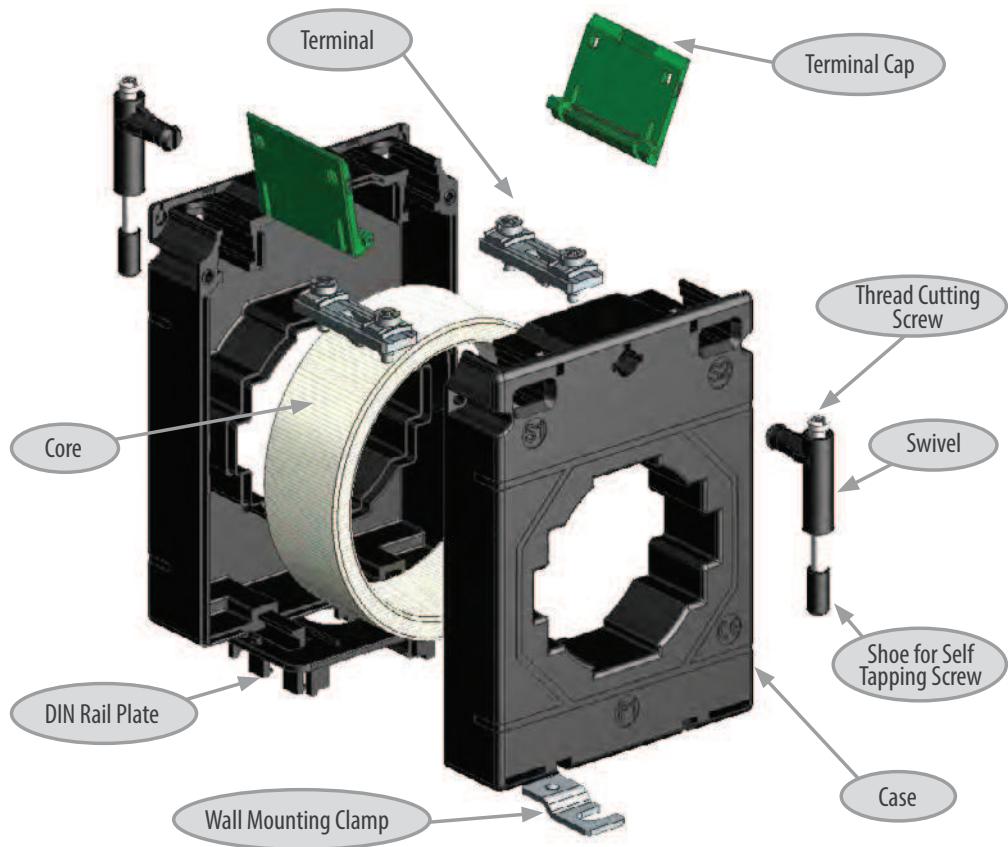

DIN rail mounting base:

(additional accessories - have to be order separately)

Order code	Transformer type	View
LH000-0904-130-123	LCTR 50/xx (30) LCTB 50/xx (30)	
LH000-0904-130-002	LCTR 45, LCTB 45	
LH000-0904-130-124	LCTM LCTR 62, LCTB 62, LCTB 74, LCTB 86, LCTB 104, LCTP	
LH000-0904-130-128 (for vertical or horizontal mounting)	LCTM, LCTR 62, LCTB 62, LCTB 74, LCTB 86, LCTB 104, LCTP	

Accessories	
Description	View
Thread cutting screw 4 x 35mm	
Thread cutting screw 4 x 45mm	
Thread cutting screw 4 x 75mm	
Wall mounting clamp	
Swivel	
Shoe for self tapping M4 screw	
Nut of M4 screw	
Locking pin	
Thread cutting screw M4 x 45 mm	

(only for transformers of LCTS type)

ACCESSORIES

Busbar mounting kit:

(delivered with each current transformer)

Kit order code	Description	No of pcs.	Transformer type
LH000-0904-130-140	Wall mounting clamp	2	LCTR 45, LCTB 45, LCTM 62W, LCTM 74W
LH000-0904-130-141	Thread cutting screw 4 x 35mm	2	LCTR 50, LCTB 50
	Wall mounting clamp	2	
	Swivel	2	
	Shoe for self tapping M4 screw	2	
LH000-0904-130-142	Thread cutting screw 4 x 45mm	2	LCTR 62, LCTB 62, LCTR 74, LCTB 86
	Wall mounting clamp	2	
	Swivel	2	
	Shoe for self tapping M4 screw	2	
LH000-0904-130-147	Thread cutting screw 4 x 35mm	6	LCTB 100/100V, LCTB 100/130V
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	6	
LH000-0904-130-143	Thread cutting screw 4 x 45mm	4	LCTB 104
	Wall mounting clamp	2	
	Swivel	4	
	Shoe for self tapping M4 screw	4	
LH000-0904-130-144	Thread cutting screw 4 x 75mm	4	LCTB 140/80, LCTB 140/100H, LCTB 140/100V
	Wall mounting clamp	2	
	Swivel	4	
	Shoe for self tapping M4 screw	4	
LH000-0904-130-145	Thread cutting screw 4 x 75mm	1	LCTB 140/130V
	Thread cutting screw 4 x 45mm	5	
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	6	
LH000-0904-130-146	Thread cutting screw 4 x 75mm	6	LCTB 225
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	6	
LH000-0904-130-623	Thread cutting screw M4 x 45mm	4	LCTS 93/30SC
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	4	
	Locking pin	1	
	Nut of M4 screw	4	
LH000-0904-130-624	Thread cutting screw M4 x 45 mm	6	LCTS 125/50SC
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	6	
	Locking pin	1	
	Nut of M4 screw	6	
LH000-0904-130-625	Thread cutting screw M4 x 45 mm	8	LCTS 155/80SC
	Wall mounting clamp	2	
	Shoe for self tapping M4 screw	8	
	Locking pin	1	
	Nut of M4 screw	8	



We are one of leading European manufacturers of electrical devices for automation and high pressure aluminium castings. We have been on the market since 1953. We have achieved our high position on the market due to continuous development policy, competence of our employees and modern equipment for research, design and production.

LUMEL is focused on 4 main activity fields:

- production of automatic devices for measurement, conversion, control and recording, transmission and visualization of various industrial processes;
- production and machining of high pressure castings and manufacturing of moulds and tools;
- design and manufacturing of control and measuring systems,
- SMT assembly, precision engineering and production of plastics parts.

We provide comprehensive solutions for various branches of industry: power industry, chemical industry, metallurgy, food industry, light industry, automotive industry, white industry and mining.

We have been working according to: ISO 9001:2015, ISO 14001:2015.

eximus[®] CS s.r.o.

IČO: 25322311, DIČ: CZ25322311, www.eximus.cz, eximus@eximus.cz

Čapkova 22
678 01 Blansko
Česká republika
Tel.: +420 - 516 432 681
+420 - 516 432 680
+420 - 516 433 983
+420 - 516 432 999